



City of Santa Barbara Water Demand

Moving 12-Month Production to Serve Potable + Recycled Systems

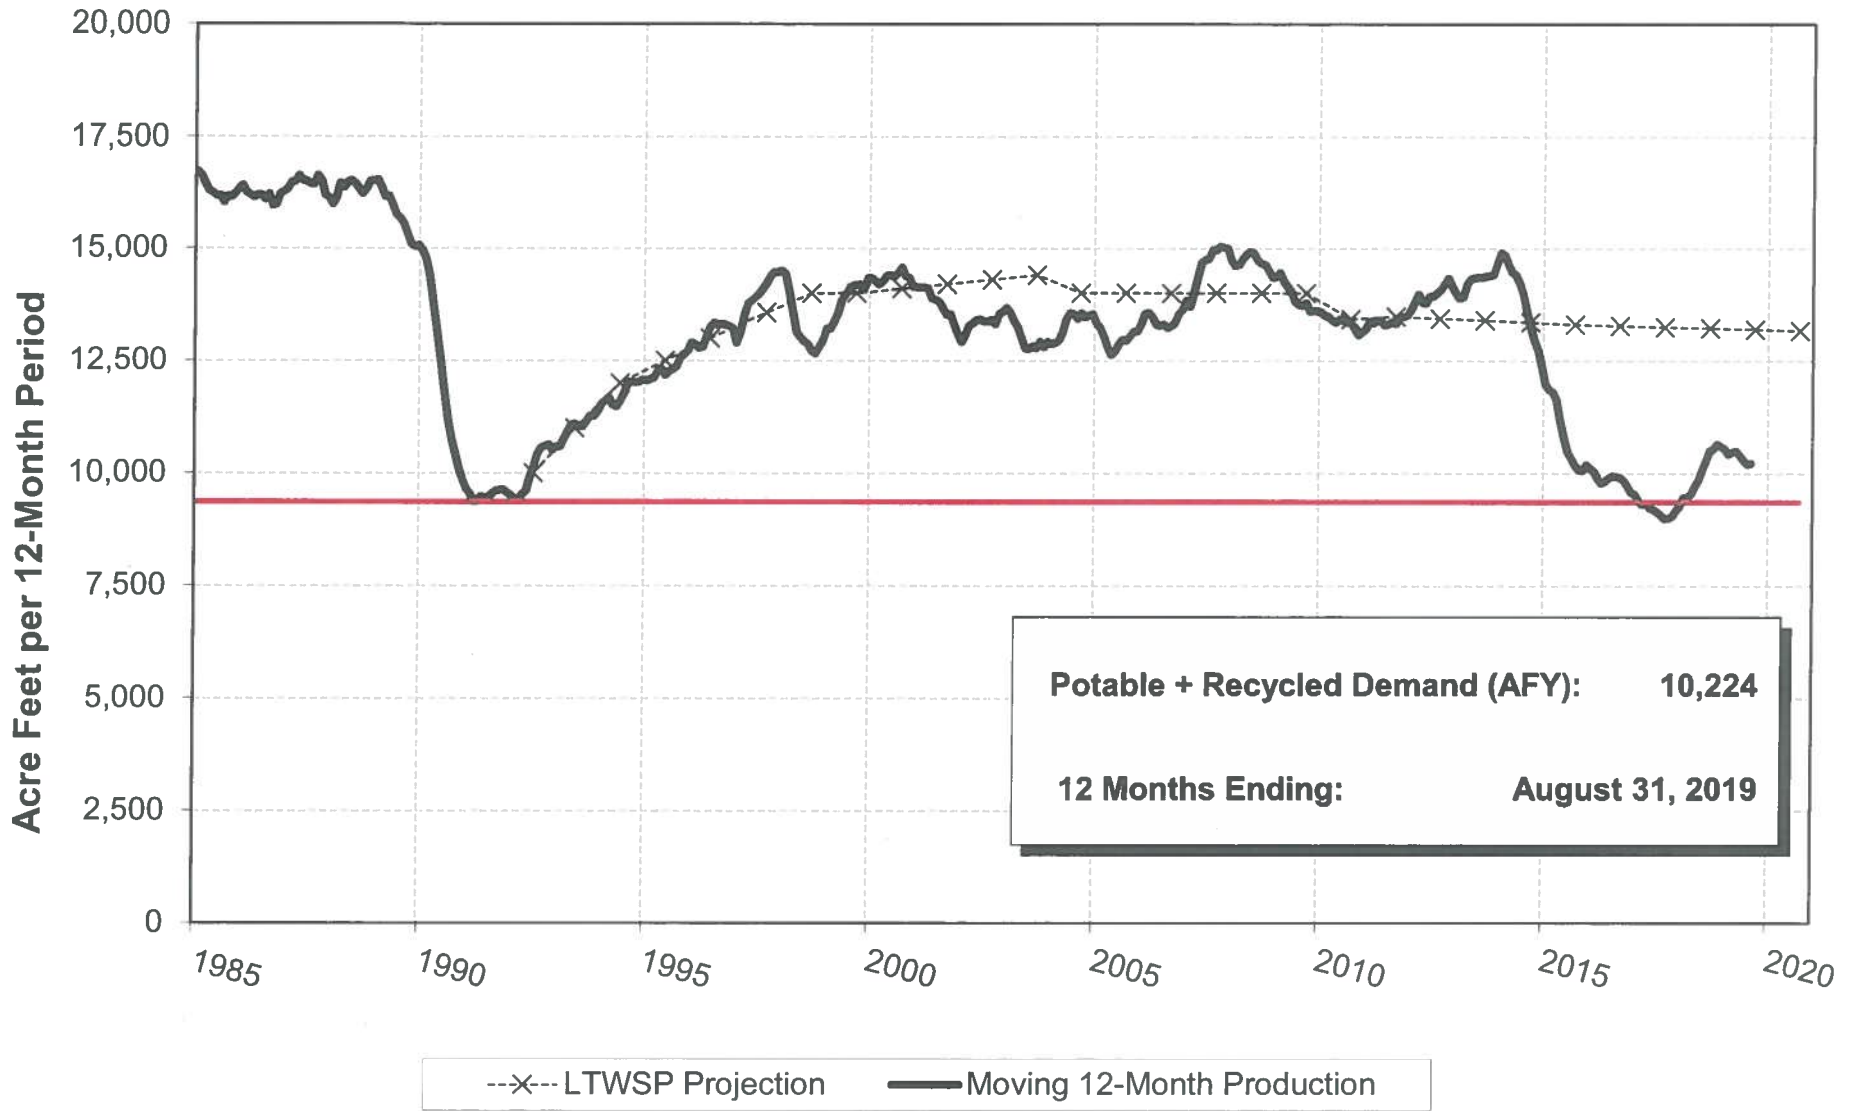

City of Santa Barbara Water Use in Gallons Per Capita per Day (GPCD) August 31, 2019


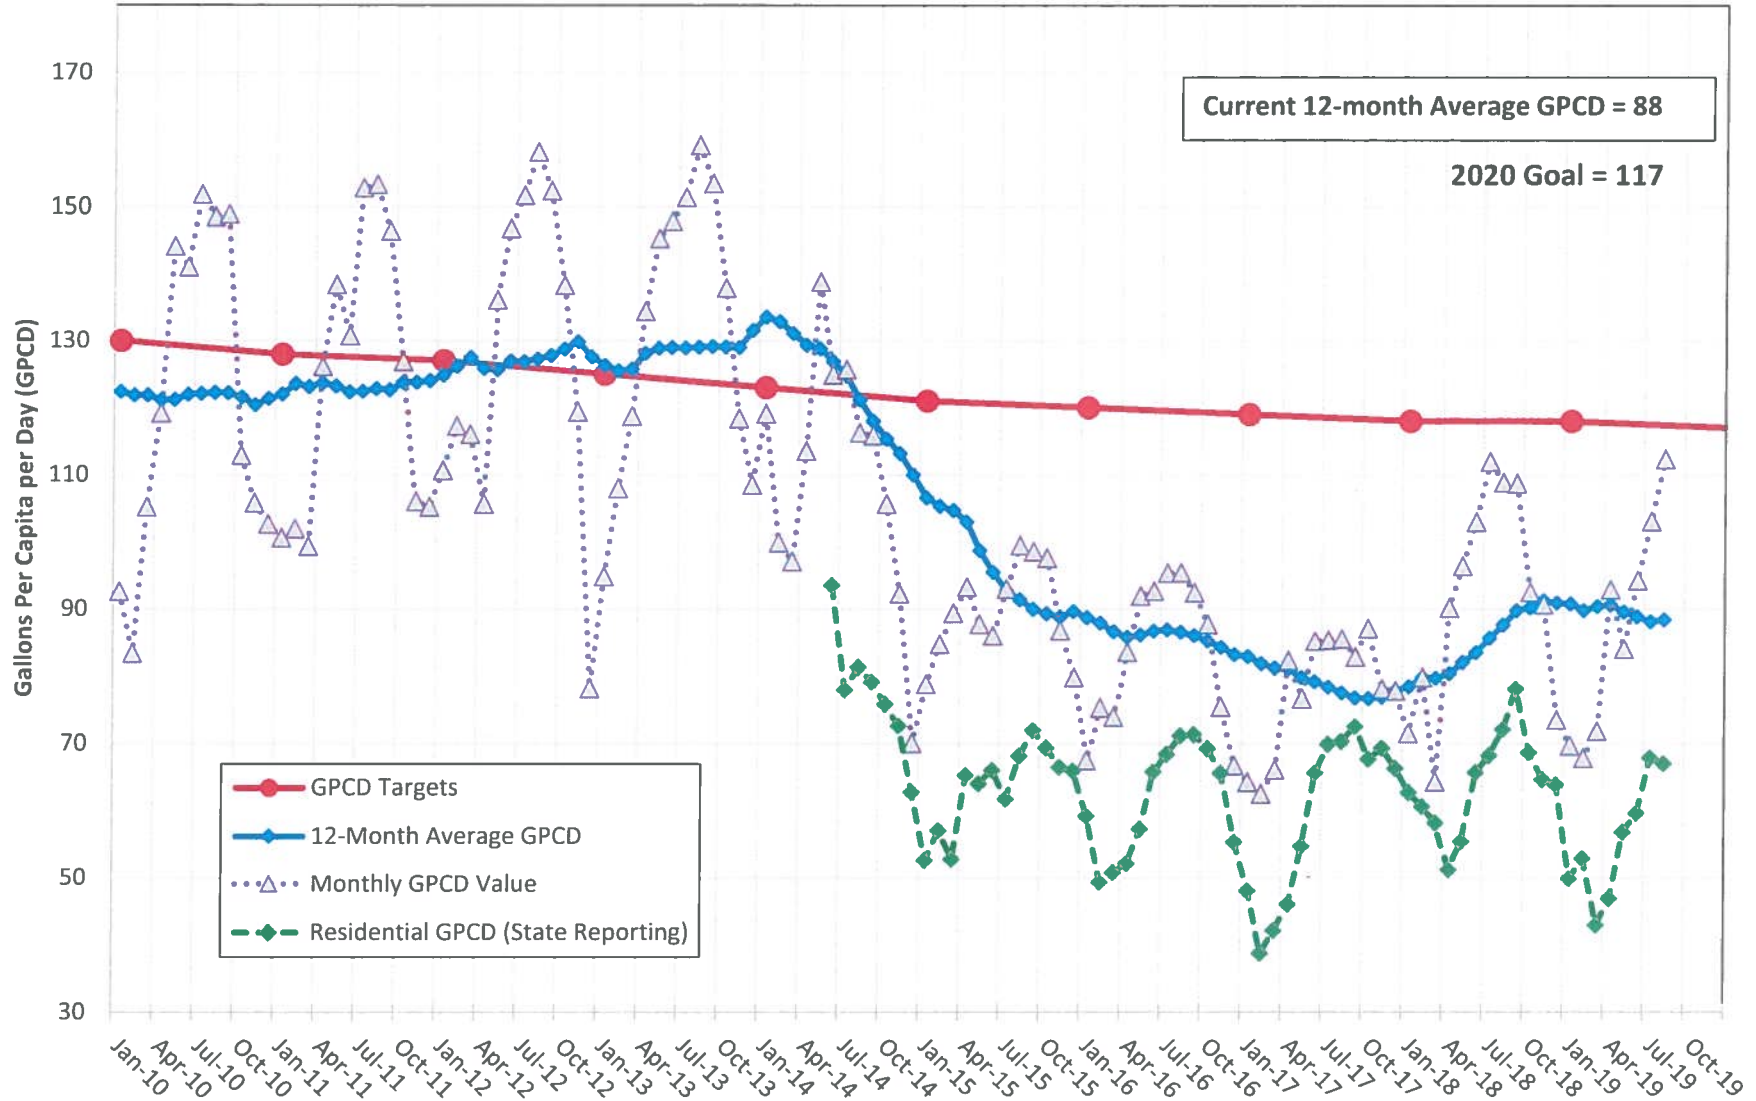



NOTE: The GPCD values above exclude blend water for recycled water production.

GIBRALTAR RAINFALL DATA

Gauge Location: Gibraltar Dam



Year	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Total
1968-69	1.19	1.07	2.22	31.18	18.23	1.67	2.81	0.00	0.00	0.00	0.00	0.00	58.37
1969-70	0.00	2.59	0.31	4.34	3.57	6.58	0.00	0.00	0.00	0.00	0.00	0.00	17.39
1970-71	0.08	9.38	8.87	1.10	1.64	0.00	0.94	0.47	0.00	0.00	0.00	0.00	22.48
1971-72	0.47	1.09	13.20	0.19	0.32	0.00	0.24	0.11	0.00	0.00	0.00	0.00	15.62
1972-73	0.55	9.10	1.06	8.38	14.89	4.27	0.00	0.00	0.00	0.00	0.00	0.00	38.25
1973-74	0.70	3.19	2.83	12.26	0.05	5.35	0.85	0.02	0.00	0.00	0.00	0.00	25.25
1974-75	0.89	0.06	9.53	0.35	5.62	8.96	2.13	0.08	0.00	0.00	0.01	0.00	27.63
1975-76	0.40	0.44	0.22	0.00	10.93	2.02	1.08	0.00	0.00	0.00	0.05	4.28	19.42
1976-77	0.25	0.44	0.83	5.42	0.26	2.89	0.00	5.19	0.00	0.00	0.38	0.00	15.66
1977-78	0.00	0.14	9.23	1.91	14.42	18.28	4.27	0.00	0.00	0.00	0.00	1.63	49.88
1978-79	0.00	2.76	2.51	8.49	6.08	7.26	0.00	0.00	0.00	0.00	0.00	1.01	28.11
1979-80	0.58	0.96	2.02	8.13	17.69	4.39	1.10	0.24	0.00	0.00	0.00	0.00	35.11
1980-81	0.00	0.00	1.74	6.17	2.99	9.98	1.05	0.00	0.00	0.00	0.00	0.00	21.93
1981-82	0.38	2.57	0.47	6.14	0.65	7.55	5.30	0.05	0.00	0.00	0.00	1.70	24.81
1982-83	1.30	7.87	5.61	15.07	8.47	15.11	8.86	0.00	0.00	0.00	0.79	0.59	63.67
1983-84	5.57	4.18	6.75	0.25	0.08	0.95	0.24	0.00	0.00	0.00	0.07	0.28	18.37
1984-85	0.49	3.52	7.94	0.96	1.24	1.92	0.13	0.00	0.00	0.00	0.00	0.05	16.25
1985-86	0.42	7.14	1.11	3.24	10.61	6.77	1.51	0.00	0.00	0.00	0.00	0.84	31.64
1986-87	0.00	0.96	0.42	2.71	2.04	4.58	0.00	0.00	0.00	0.00	0.00	0.00	10.71
1987-88	1.60	1.52	4.67	5.19	4.12	2.60	5.14	0.06	0.05	0.00	0.00	0.00	24.95
1988-89	0.00	1.04	5.73	0.29	5.38	1.43	0.13	0.46	0.00	0.00	0.00	0.25	14.71
1989-90	0.79	0.58	0.00	5.61	3.33	0.27	0.24	0.78	0.00	0.00	0.00	0.20	11.80
1990-91	0.00	0.26	0.18	1.71	4.88	23.12	0.03	0.00	0.06	0.38	0.00	0.00	30.62
1991-92	0.33	0.13	7.54	4.72	18.82	7.28	0.04	0.16	0.00	0.07	0.00	0.00	39.09
1992-93	1.78	0.00	8.17	14.30	16.43	8.12	0.00	0.34	0.47	0.00	0.00	0.00	49.61
1993-94	0.19	1.51	2.42	1.74	9.76	2.72	0.65	0.51	0.00	0.00	0.00	0.09	19.59
1994-95	2.19	1.29	1.54	33.26	3.39	15.30	0.33	1.64	0.02	0.00	0.00	0.00	58.96
1995-96	0.00	0.18	2.85	2.93	10.30	2.21	1.00	0.39	0.00	0.00	0.00	0.00	19.86
1996-97	7.05	1.89	7.81	7.45	0.13	0.00	0.00	0.00	0.00	0.04	0.00	0.09	24.46
1997-98	0.00	5.48	10.17	6.64	34.63	4.47	4.43	6.62	0.03	0.00	0.00	0.55	73.02
1998-99	0.13	1.30	0.79	4.25	2.24	4.55	2.97	0.00	0.13	0.24	0.00	0.03	16.63
1999-00	0.00	1.65	0.00	2.25	16.70	3.73	5.36	0.03	0.19	0.00	0.00	0.00	29.91
2000-01	4.04	0.00	0.15	11.24	8.85	13.59	2.96	0.01	0.00	0.01	0.00	0.00	40.85
2001-02	0.65	4.48	2.89	1.03	0.33	0.84	0.08	0.09	0.00	0.00	0.00	0.06	10.45
2002-03	0.00	4.61	6.45	0.12	5.26	4.43	4.97	2.82	0.00	0.06	0.00	0.00	28.72
2003-04	0.00	2.29	3.10	0.42	8.50	0.43	0.00	0.00	0.00	0.00	0.00	0.00	14.74
2004-05	8.39	0.46	17.37	21.54	15.65	3.58	1.14	1.46	0.00	0.00	0.00	0.14	69.73
2005-06	0.60	1.43	0.68	9.67	5.41	5.22	8.15	1.29	0.00	0.00	0.10	0.00	32.55
2006-07	0.37	0.23	1.63	2.62	3.40	0.16	0.81	0.00	0.00	0.00	0.02	0.85	10.09
2007-08	0.38	0.10	4.09	23.84	3.11	0.00	0.15	0.27	0.00	0.00	0.10	0.00	32.04
2008-09	0.06	2.22	4.07	1.00	7.95	0.90	0.35	0.01	0.09	0.00	0.00	0.00	16.65
2009-10	5.81	0.00	5.19	11.89	6.90	0.69	4.44	0.08	0.00	0.00	0.00	0.00	35.00
2010-11	2.03	2.04	14.04	2.06	5.12	14.95	0.00	1.18	0.51	0.00	0.00	0.00	41.93
2011-12	0.74	3.00	0.36	1.22	0.47	5.89	3.08	0.00	0.00	0.00	0.00	0.04	14.80
2012-13	0.34	2.60	2.68	1.39	0.24	1.02	0.00	0.61	0.00	0.00	0.00	0.00	8.88
2013-14	0.08	1.21	0.29	0.00	5.07	5.16	0.66	0.57	0.00	0.00	0.00	0.00	13.04
2014-15	0.00	1.21	7.88	0.87	0.73	0.60	0.36	0.62	0.98	0.00	0.00	0.16	13.41
2015-16	0.23	0.36	0.71	4.66	2.66	4.22	0.27	0.13	0.00	0.00	0.00	0.00	13.24
2016-17	1.20	1.26	3.10	11.51	14.23	1.24	0.21	0.45	0.00	0.00	0.02	0.23	33.45
2017-18	0.00	0.07	0.00	3.92	0.28	7.13	0.13	0.30	0.00	0.00	0.00	0.00	11.83
2018-19	0.18	4.82	0.94	11.65	11.79	4.97	0.12	1.91	0.00	0.00	0.00		36.38
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Total
50 yr avg	1.02	2.11	4.04	5.92	6.75	5.15	1.52	0.58	0.05	0.02	0.03	0.26	27.90
50 yr median	0.38	1.30	2.76	4.09	5.10	4.33	0.36	0.09	0.00	0.00	0.00	0.00	24.64
Average YTD:	1.02	3.14	7.18	13.10	19.85	25.01	26.53	27.10	27.16	27.17	27.20		
Actual YTD:	0.18	5.00	5.94	17.59	29.38	34.35	34.47	36.38	36.38	36.38	36.38		

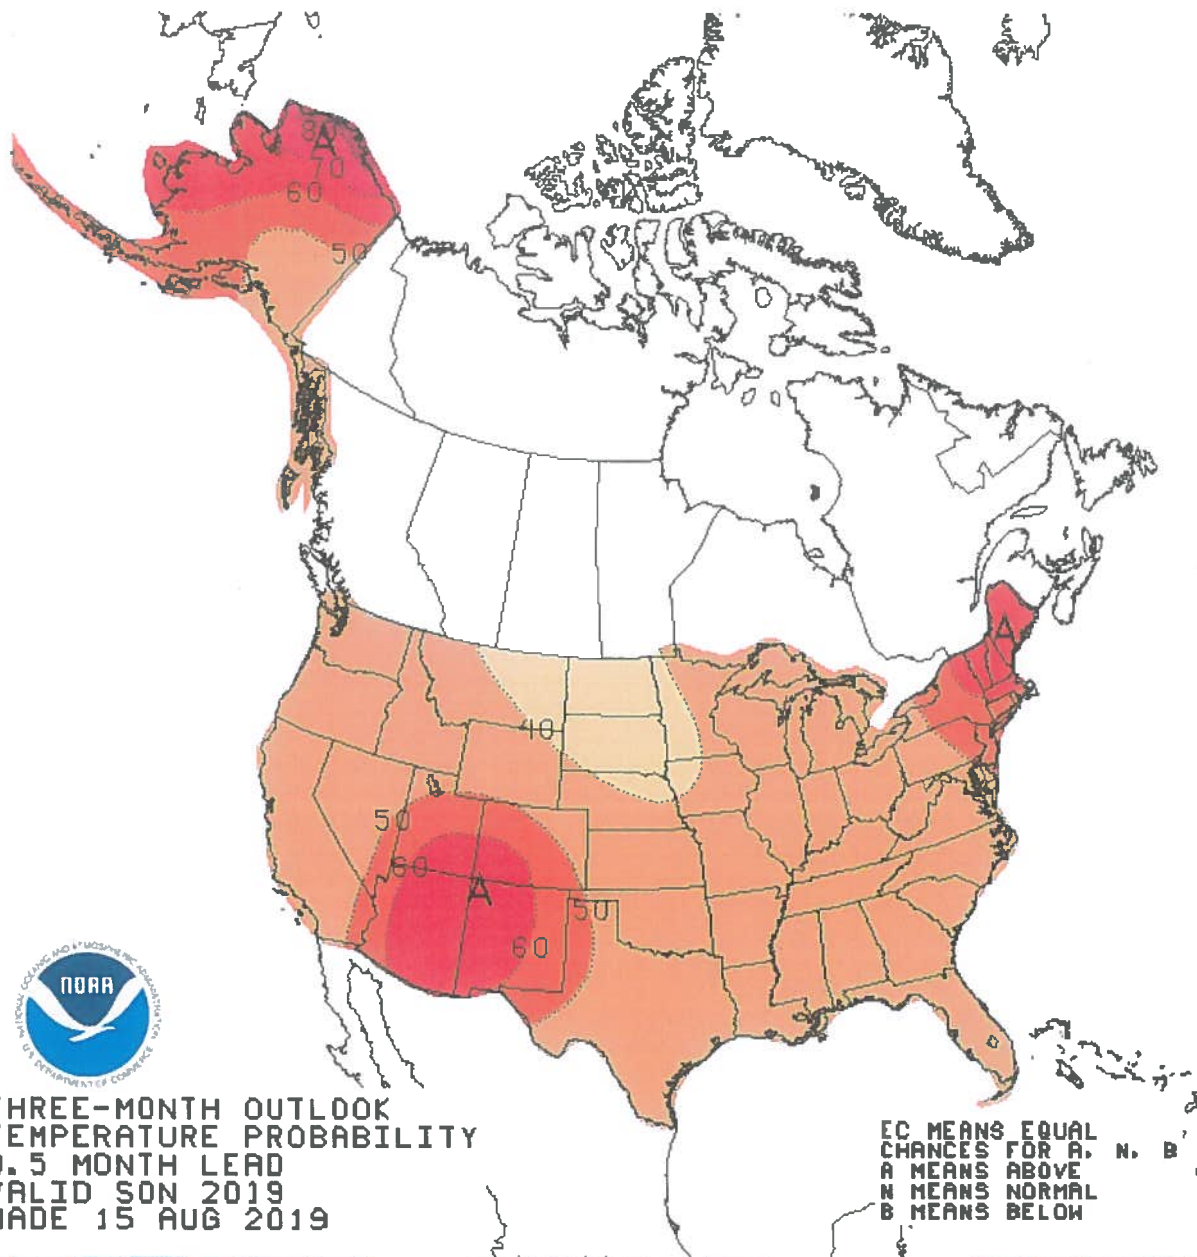

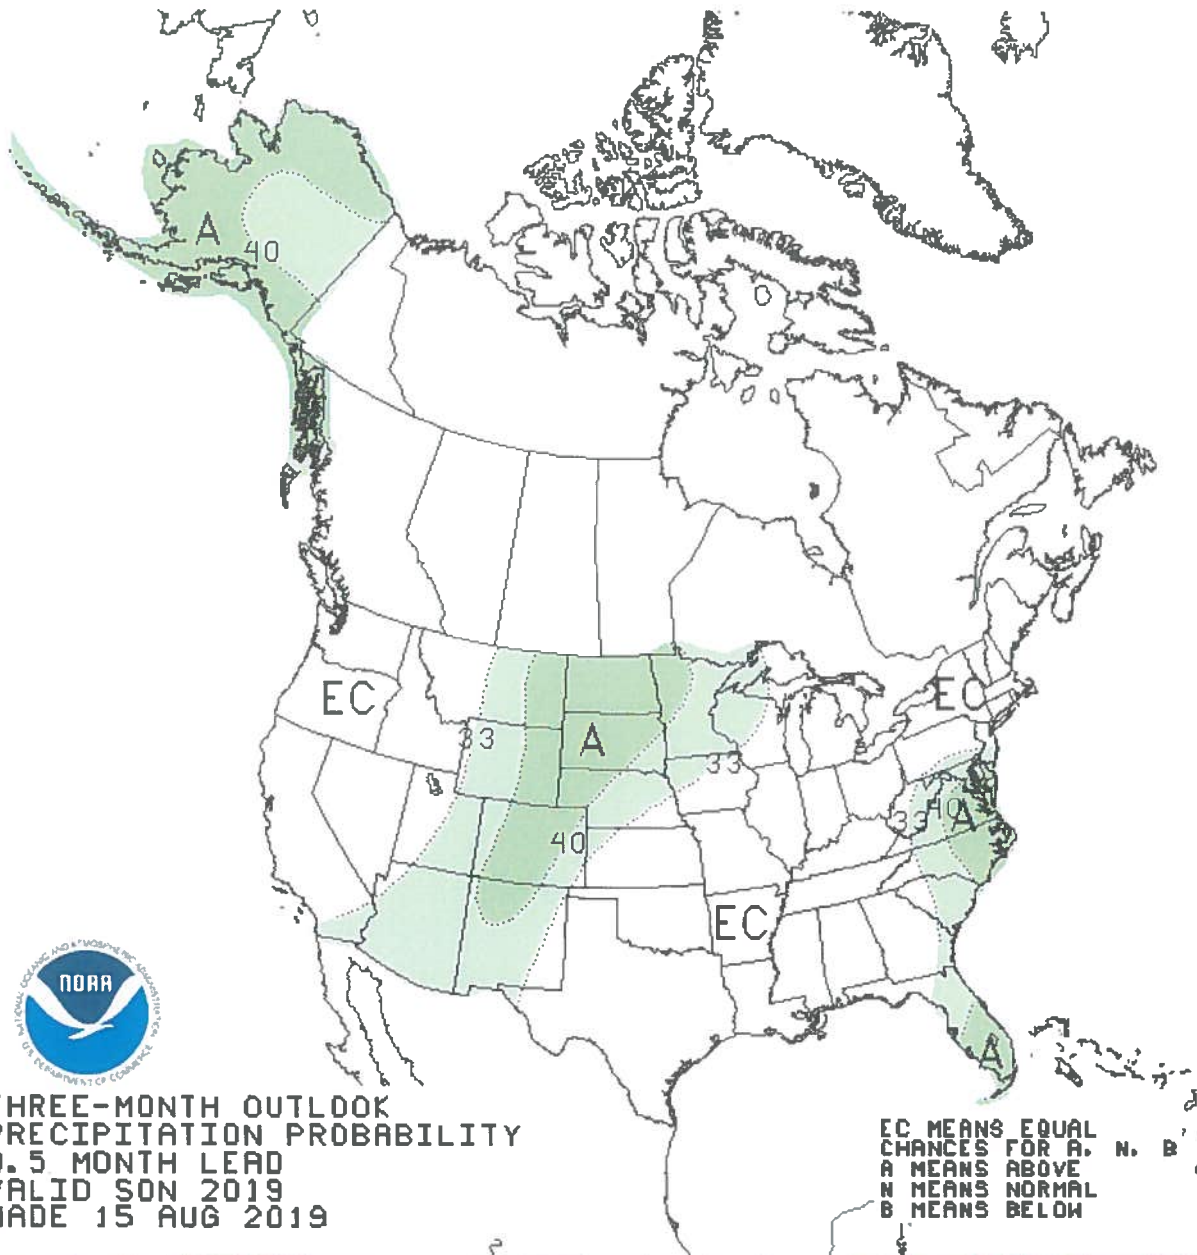


**THREE-MONTH OUTLOOK
PRECIPITATION PROBABILITY
0.5 MONTH LEAD
VALID SON 2019
MADE 15 AUG 2019**

**EC MEANS EQUAL
CHANCES FOR A, N, B
A MEANS ABOVE
N MEANS NORMAL
B MEANS BELOW**



GIBRALTAR RESERVOIR HYDROGRAPH WATER IN STORAGE and FEET BELOW SPILL

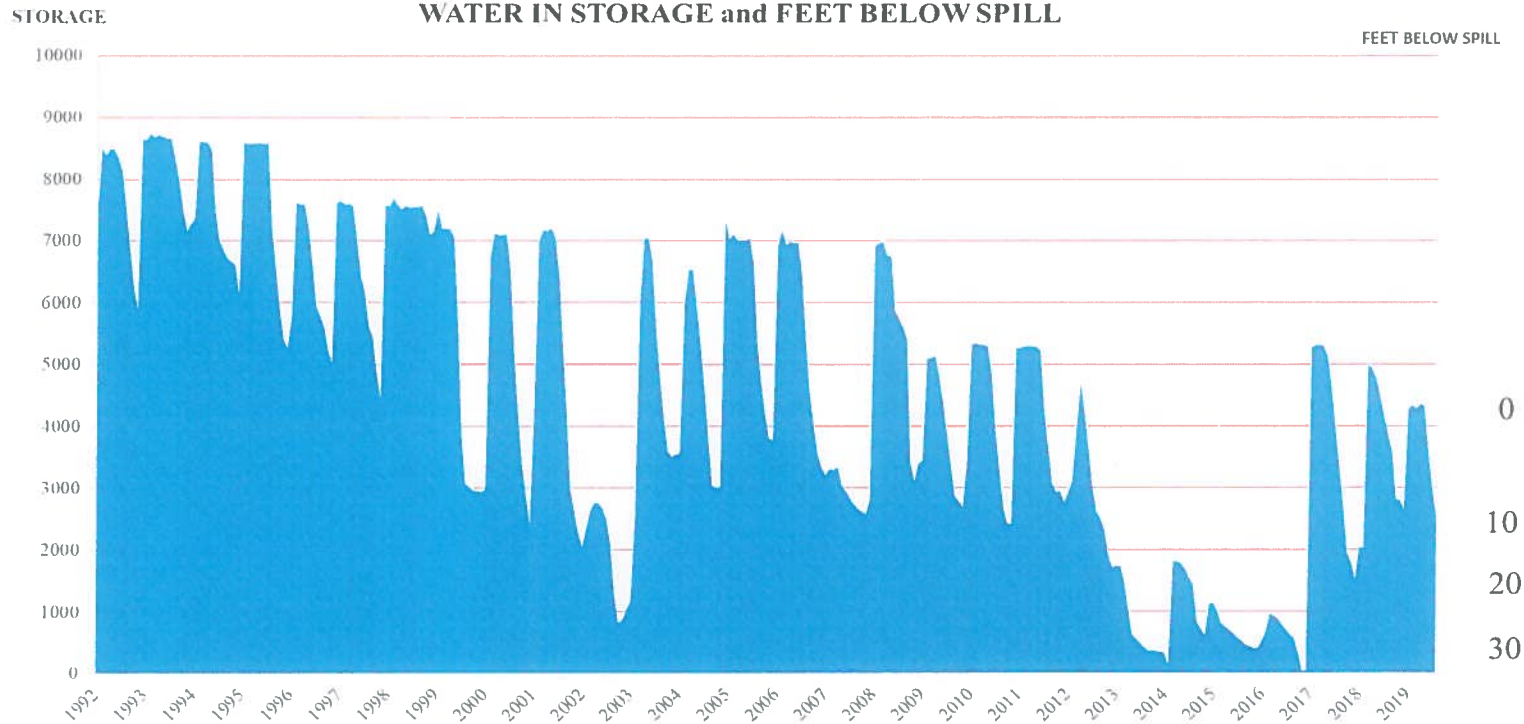

<u>ELEV.</u>	<u>STATUS</u>	<u>CAPACITY (AF)</u>
1,400.00	Reservoir is Full	5,246
1,376.48	First 16" Intake Valve	1,156
1,361.82	Second 16" Intake Valve	0
1,300.00	Reservoir is Empty	0


January 1993 - February 1996... Reflects use of M,N&S 1992 Gib. Area/Capacity Survey @ 8,618 AF
 February 1996 - October 1998... Reflects use of M,N&S 1996 Gib. Area/Capacity Survey @ 7,631 AF
 October 1998 - December 2001... Reflects use of M,N&S 1998 Gib. Area/Capacity Survey @ 7,261 AF
 January 2002 - December 2004... Reflects use of M,N&S 2001 Gib. Area/Capacity Survey @ 7,096 AF
 January 2005 - November 2007... Reflects use of M,N&S 2004 Gib. Area/Capacity Survey @ 7,085 AF
 December 2007 - July 2008... Reflects use of M,N&S 2007 Gib. Area/Capacity Survey @ 6,784 AF
 August 2008 - May 2010... Reflects use of MN&S 2008 Gib. Area/Capacity Survey @ 5,303 AF
 June 2010 - September 2013... Reflects use of MN&S 2010 Gib. Area/Capacity Survey @ 5,251 AF
 October 2013 - September 2016... Reflects use of MN&S 2013 Gib. Area/Capacity Survey @ 5,246 AF
 October 2016 to September 2017... Reflects use of MNS 2016 Gib. Area/Capacity Survey @ 5,272 AF
 October 2017 to September 2018... Reflects use of MNS 2017 Gib. Area/Capacity Survey @ 4,968 AF
 October 2018 to present... Reflects use of MNS 2018 Gib. Area/Capacity Survey @ 4,314 AF

TIME & DATE OF SPILL SINCE 1989


4:30 Am	March 19, 1991
9:09 Am	February 7, 1992
10:30 Am	January 7, 1993
6:45 Am	February 18, 1994
1:37 Pm	January 9, 1995
2:10 Pm	February 20, 1996
6:00 Am	December 22, 1996
3:00 Am	January 2, 1997
1:30 Pm	January 15, 1997
9:40 Am	December 6, 1997
4:30 Pm	February 6, 1999
8:00 Am	February 24, 2000
1:00 Am	January 15, 2001
1:30 Pm	April 14, 2003
5:00 Pm	December 29, 2004
8:30 Pm	January 2, 2006
1:00 Am	January 5, 2008
7:00 Pm	February 16, 2009
12:00 Noon	January 20, 2010
07:00 Am	December 20, 2010
01:00 Am	January 24, 2017
07:30 Am	March 29, 2018
09:30 Am	January 17, 2019

Cachuma Storage: Current Drought & 1986-93 Period


Data Shown Through August 31, 2019

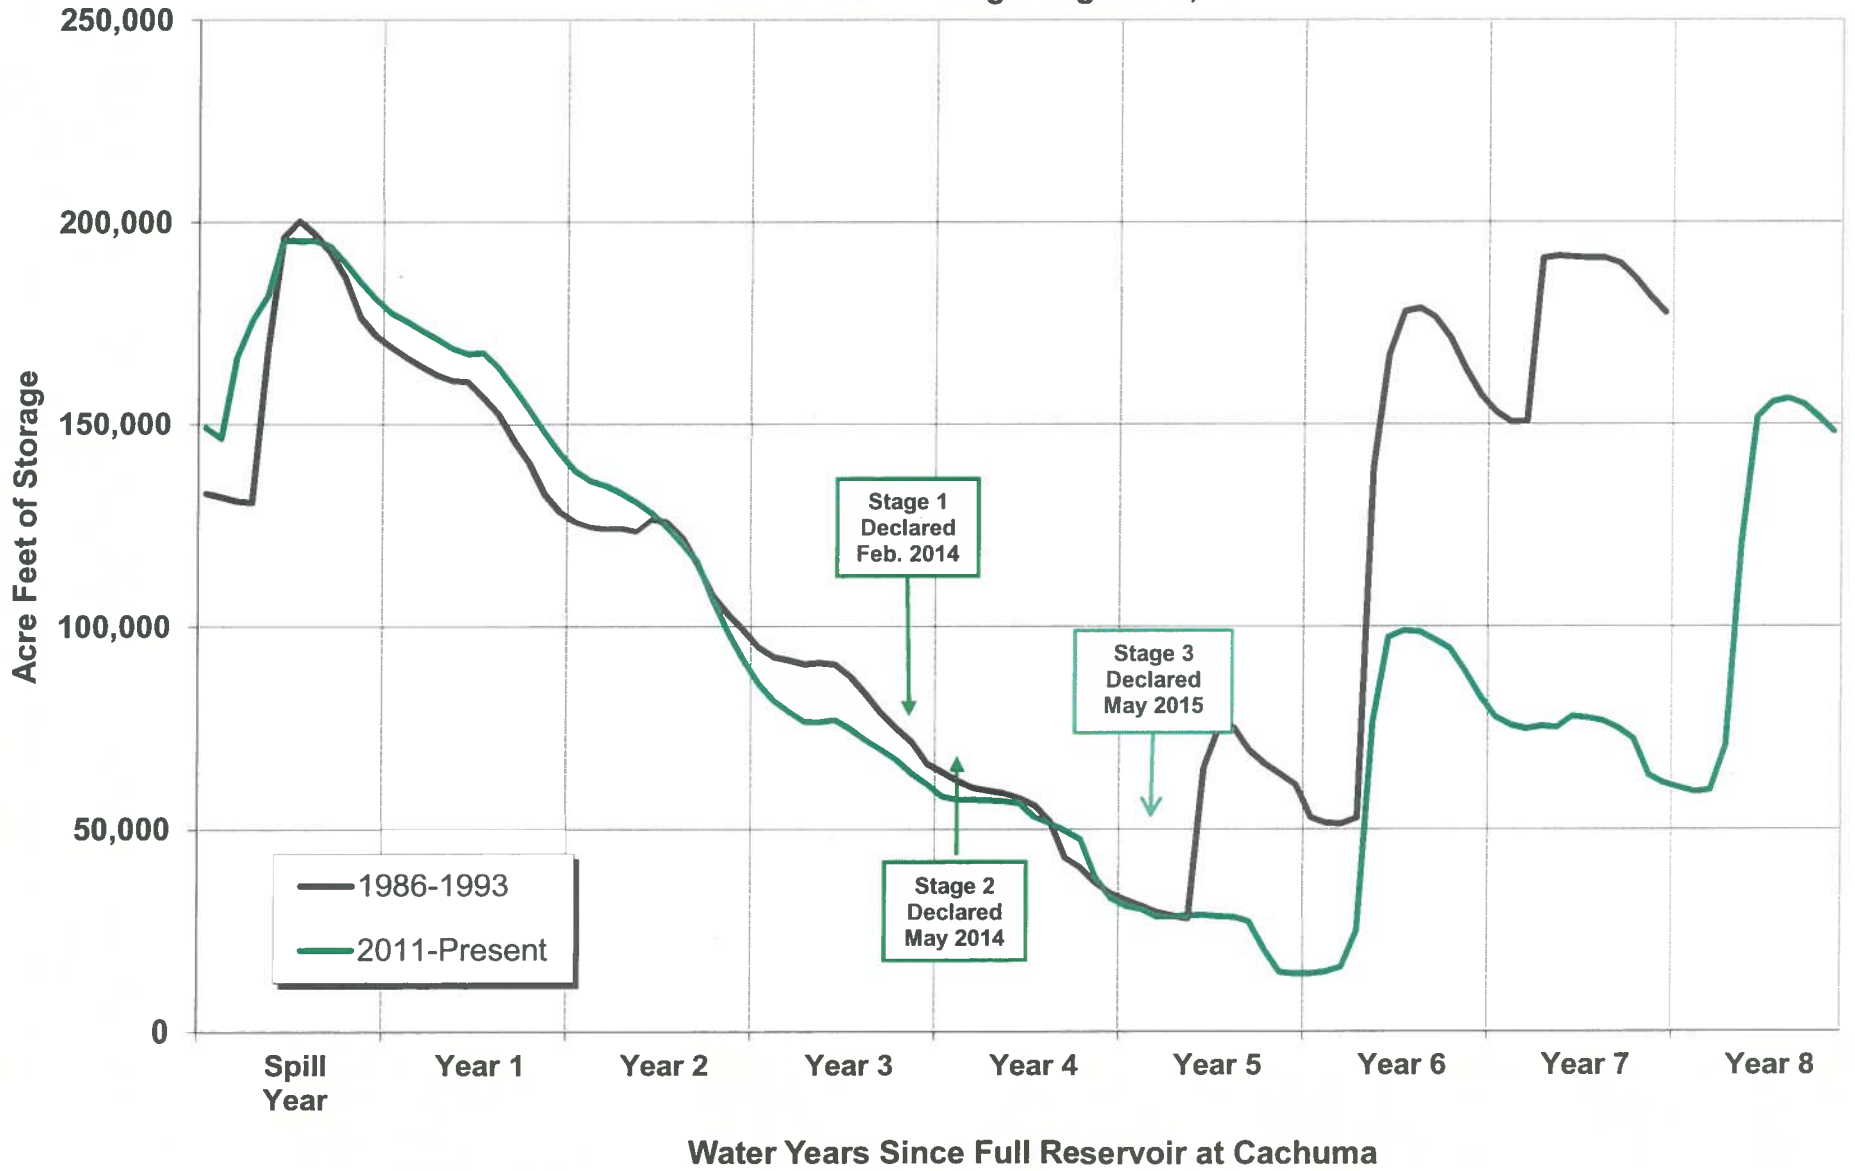


Foothill Basin: Historical Groundwater Levels and Pumping

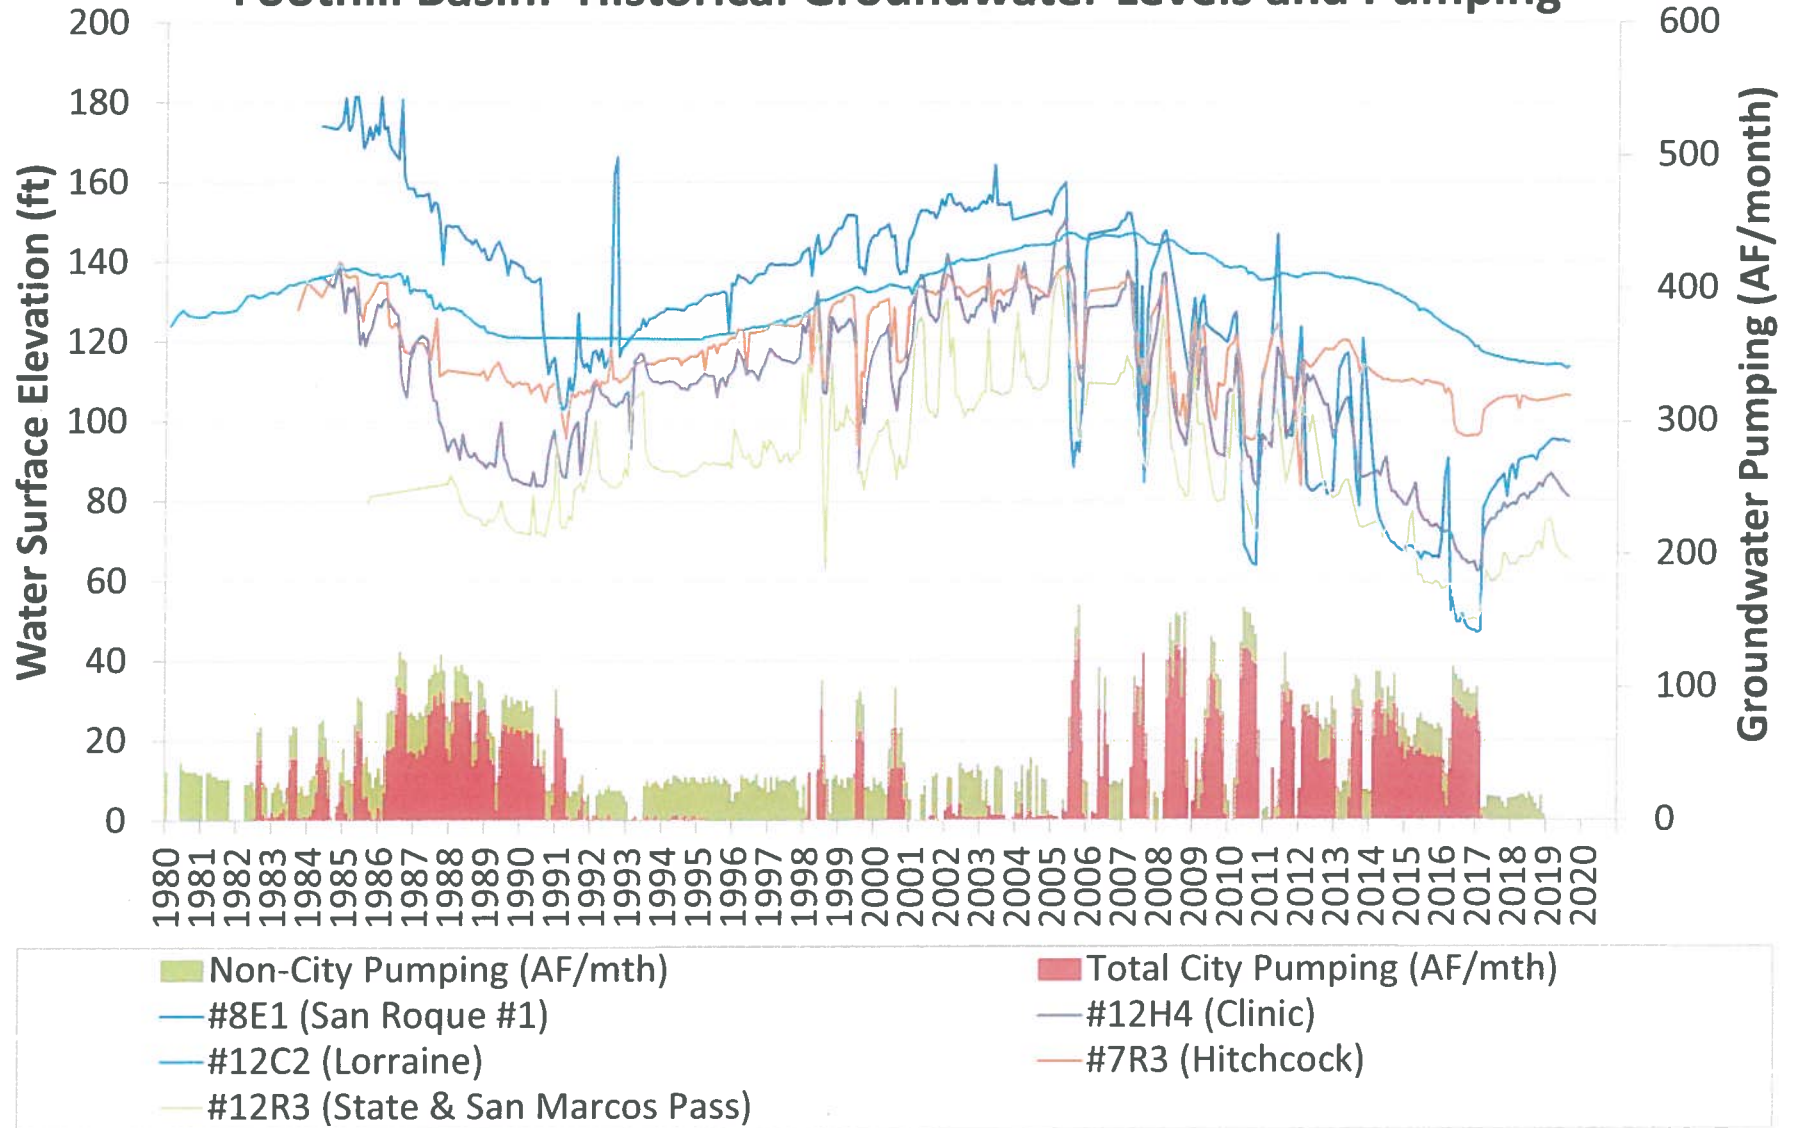

Storage Unit #1, Upper Producing Zone: Historical Groundwater Levels and Pumping

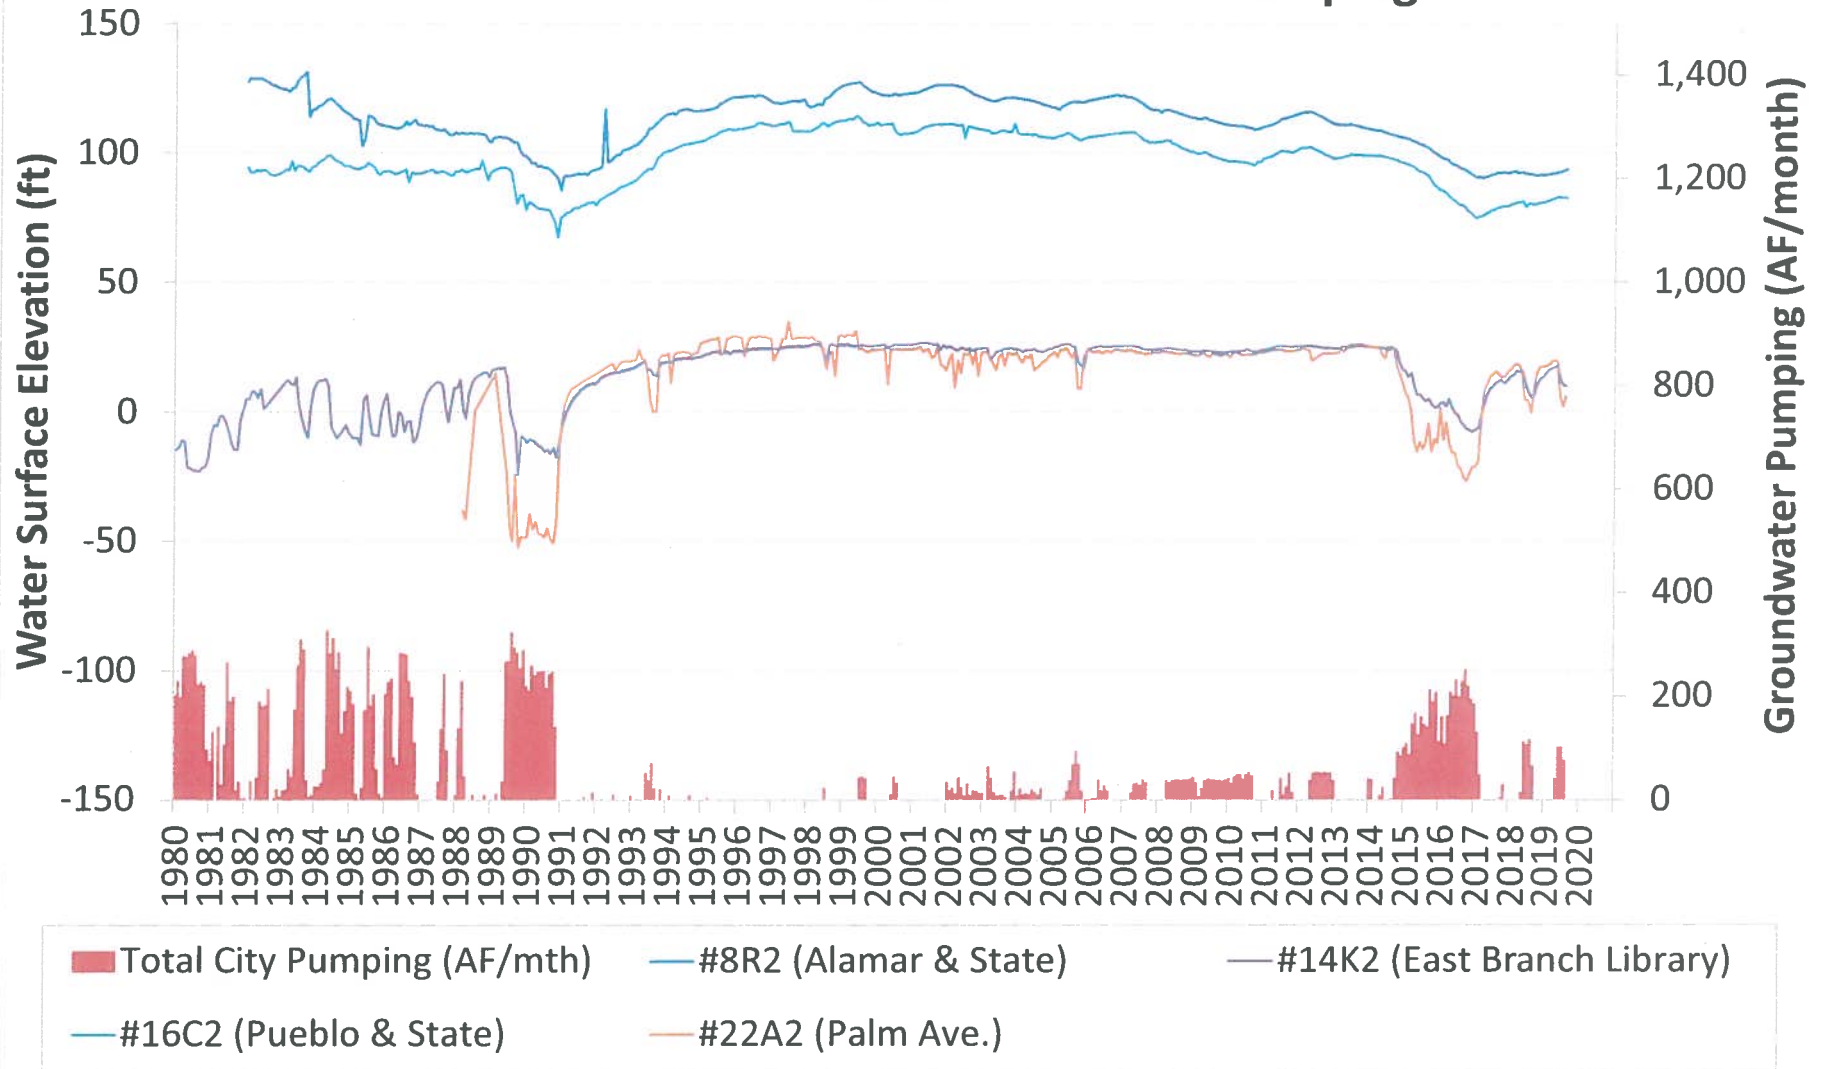


Storage Unit #1, Lower Producing Zone: Historical Groundwater Levels and Pumping

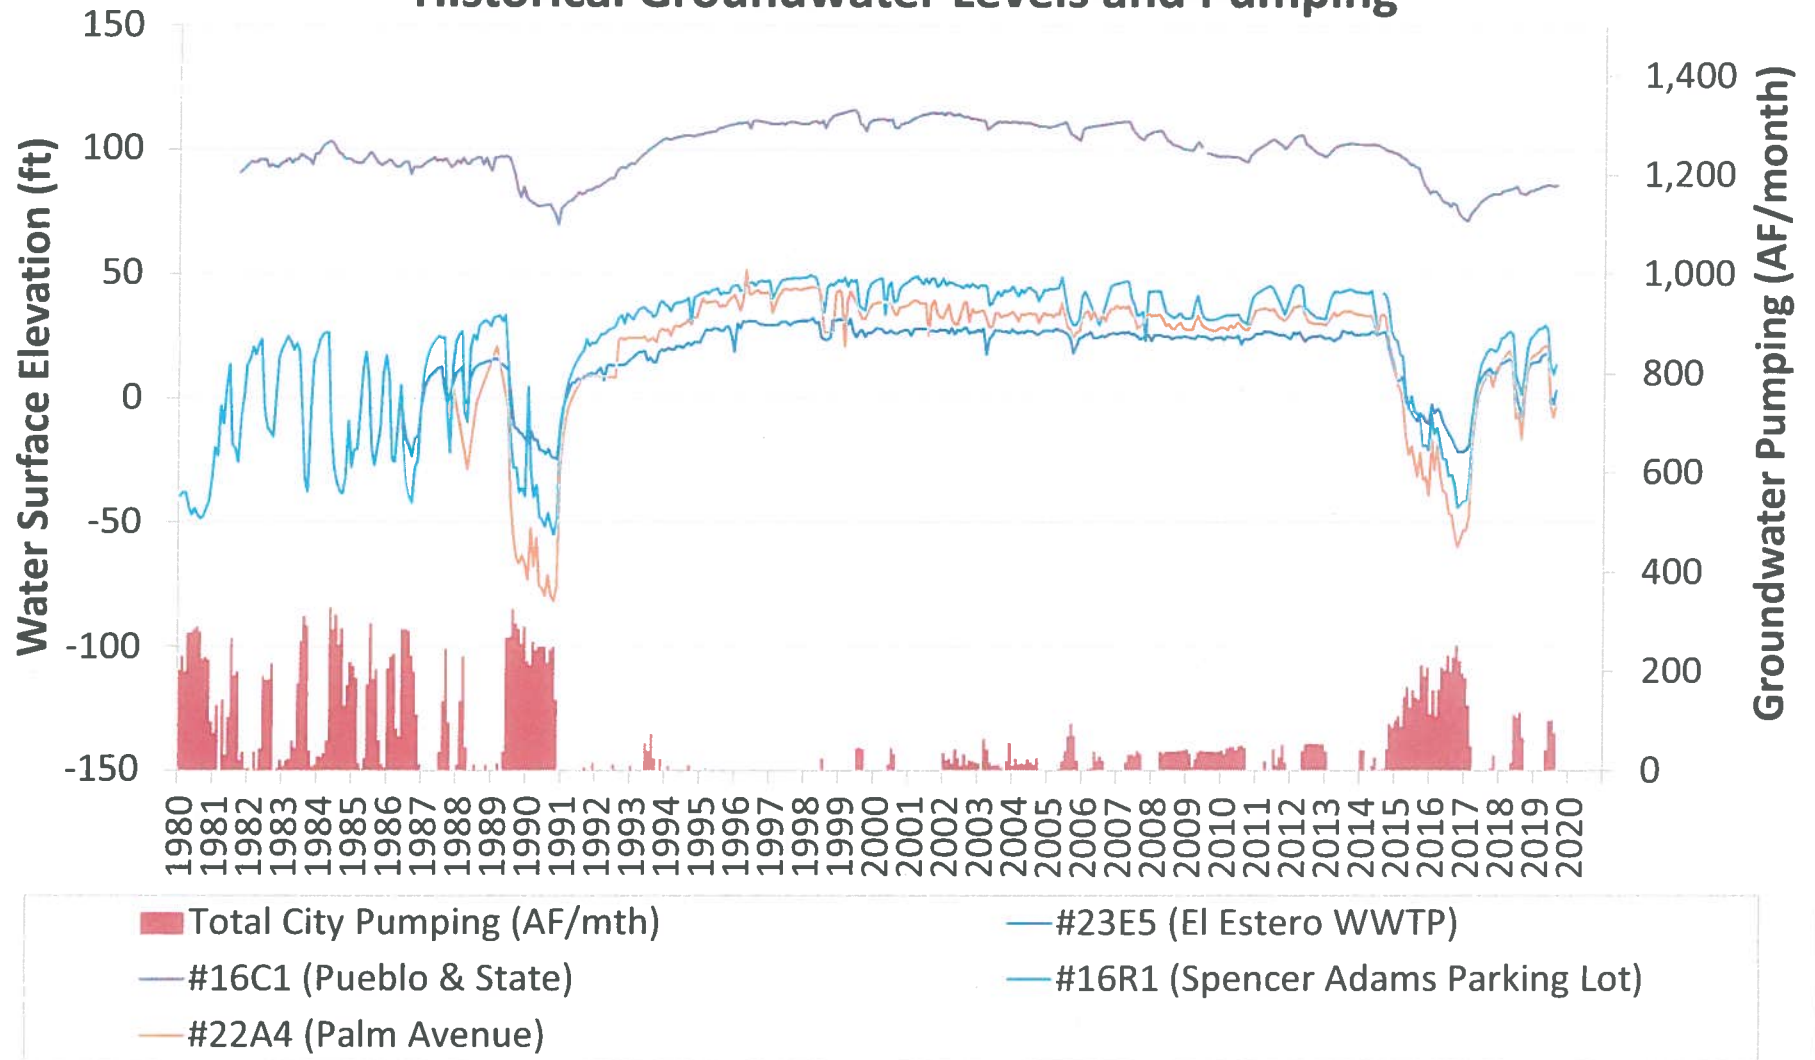


EL ESTERO INFLUENT FLOW COMPARISON

	2017	2018	2019
January	6.777	6.106	6.616
February	8.177	5.987	7.790
March	6.382	6.605	7.363
April	6.224	6.203	6.523
May	6.080	6.168	6.462
June	6.162	6.365	6.441
July	6.338	6.277	6.460
August	6.389	6.482	6.525
September	6.390	6.247	
October	6.341	6.153	
November	6.071	6.123	
December	5.464	5.863	

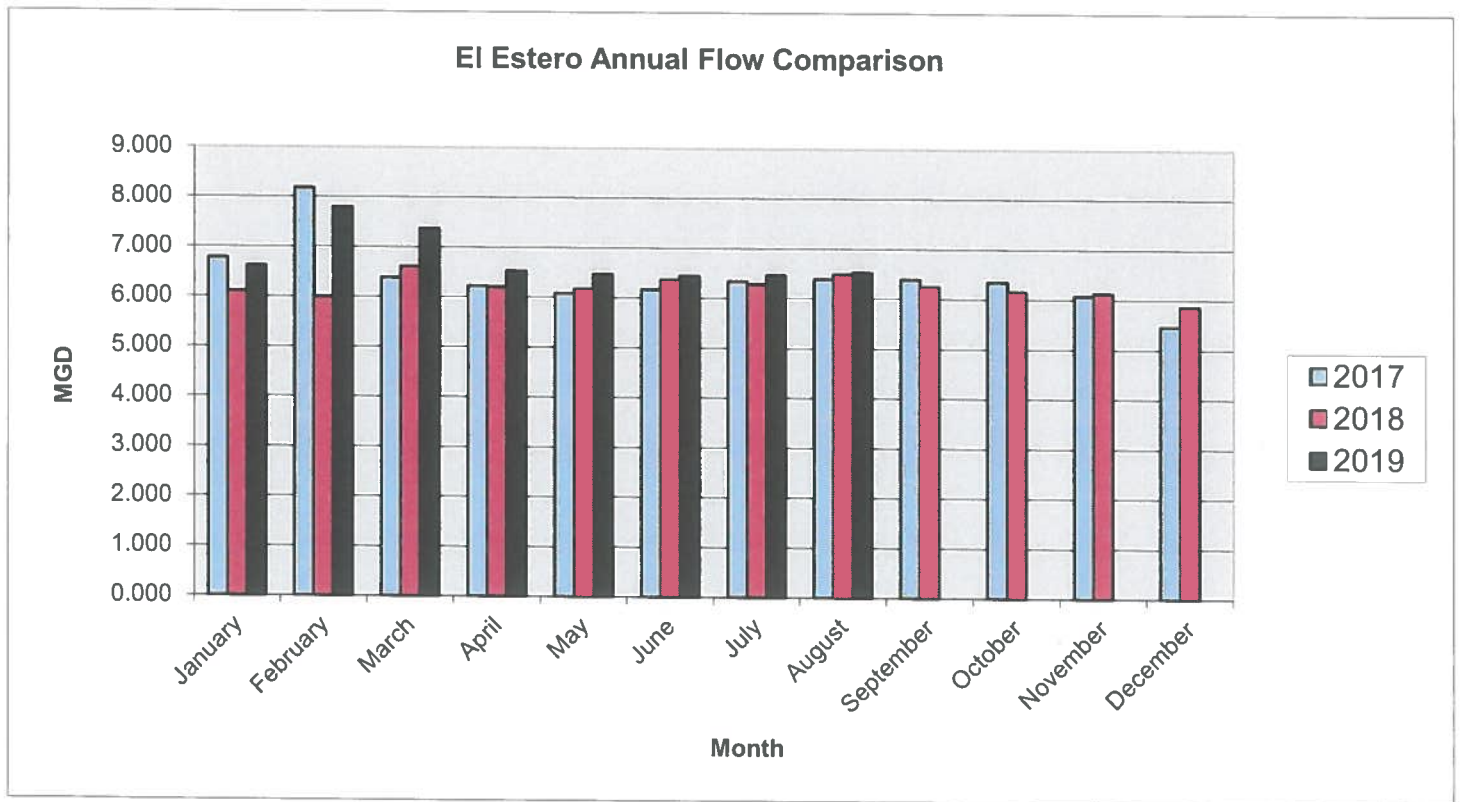

Annual Flow is Calculated Adjusted Influent Flow

Recycled Production by Source of Supply for 2019 (Acre-Feet)

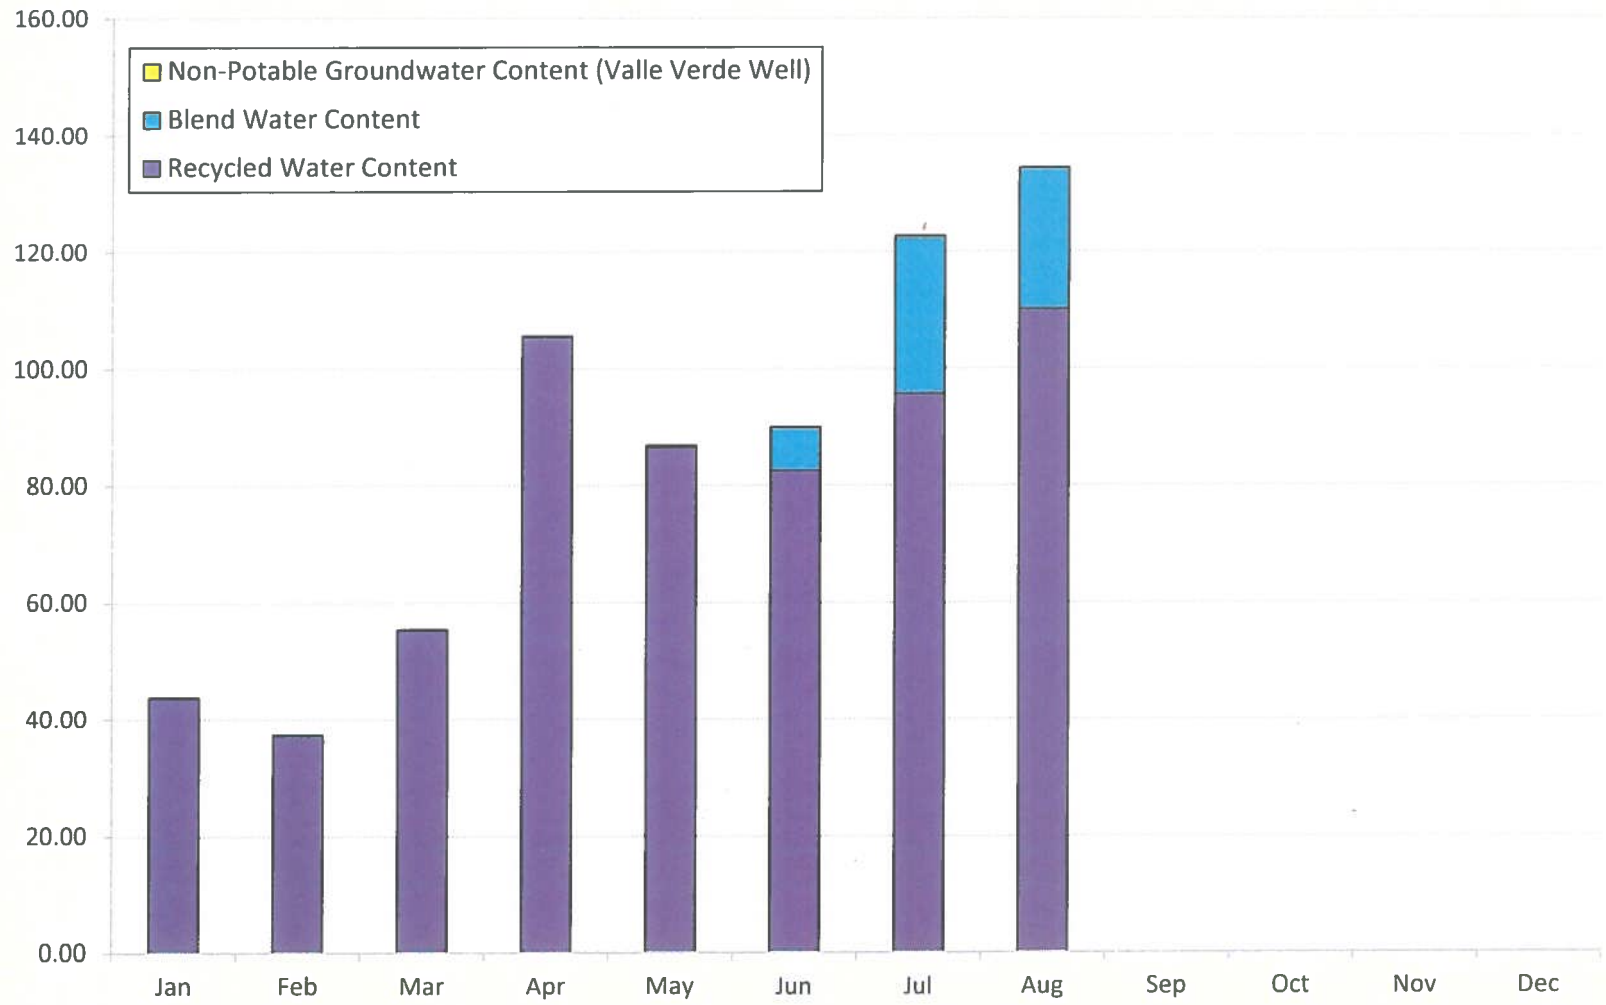



City of Santa Barbara
Public Works Department

Interoffice Memorandum

DATE: September 16, 2019
TO: Water Commission
FROM: Joshua Haggmark, Water Resources Manager
SUBJECT: Water Supply Update

Following is the status of implementation of Pass Through Operations under the 1989 Upper Santa Ynez River Operations Agreement ("Pass Through Agreement"). There have been no significant changes since the last update, which is provided below.

Reclamation's Environmental Assessment and Finding of No Significant Impact

City staff presented Reclamation with responses to their remaining technical questions. City staff continues to wait for a response from the Area Manager regarding remaining issues on Reclamation's EA.

Warren Act Contract

In parallel with the above, negotiations continue on suitable language for the Warren Act contract. Staff is working to ensure that Reclamation's standard template is modified as necessary to reflect the unique provisions of the Pass Through Agreement. The effort also includes consideration of Warren Act requirements associated with the conveyance of Gibraltar water through Cachuma Project facilities, specifically Lauro Reservoir. Staff met with Reclamation on June 6, 2018 to clarify the City's water rights as they relate to the draft contract. Staff met with Reclamation again on September 6, 2018 to further develop suitable Warren Act contract language and to further clarify the City's water rights.

cc: Cathy Taylor, Acting Water Supply Manager

DC/