



City of Santa Barbara  
**Fire Prevention Bureau**  
**Access & Hydrant Information**

**Page Number**

1 ..... Fire Hydrant (*Commercial & Industrial*)

2 ..... Fire Hydrant (*Residential*)

3 ..... Commercial Driveway Requirements

4 ..... Residential Driveway Requirements

5 ..... Cul de Sac Minimum Requirements

6 ..... Minimum Turning Radius (*Streets & Driveways*)


7 ..... Location of Hammerhead Turnaround


8 ..... Hammerhead Turnaround Dimensions

9 ..... Access/Driveway Construction & Slope

# Commercial & Industrial Hydrants

All exterior walls must be within 300' of a fire hydrant by way of access.

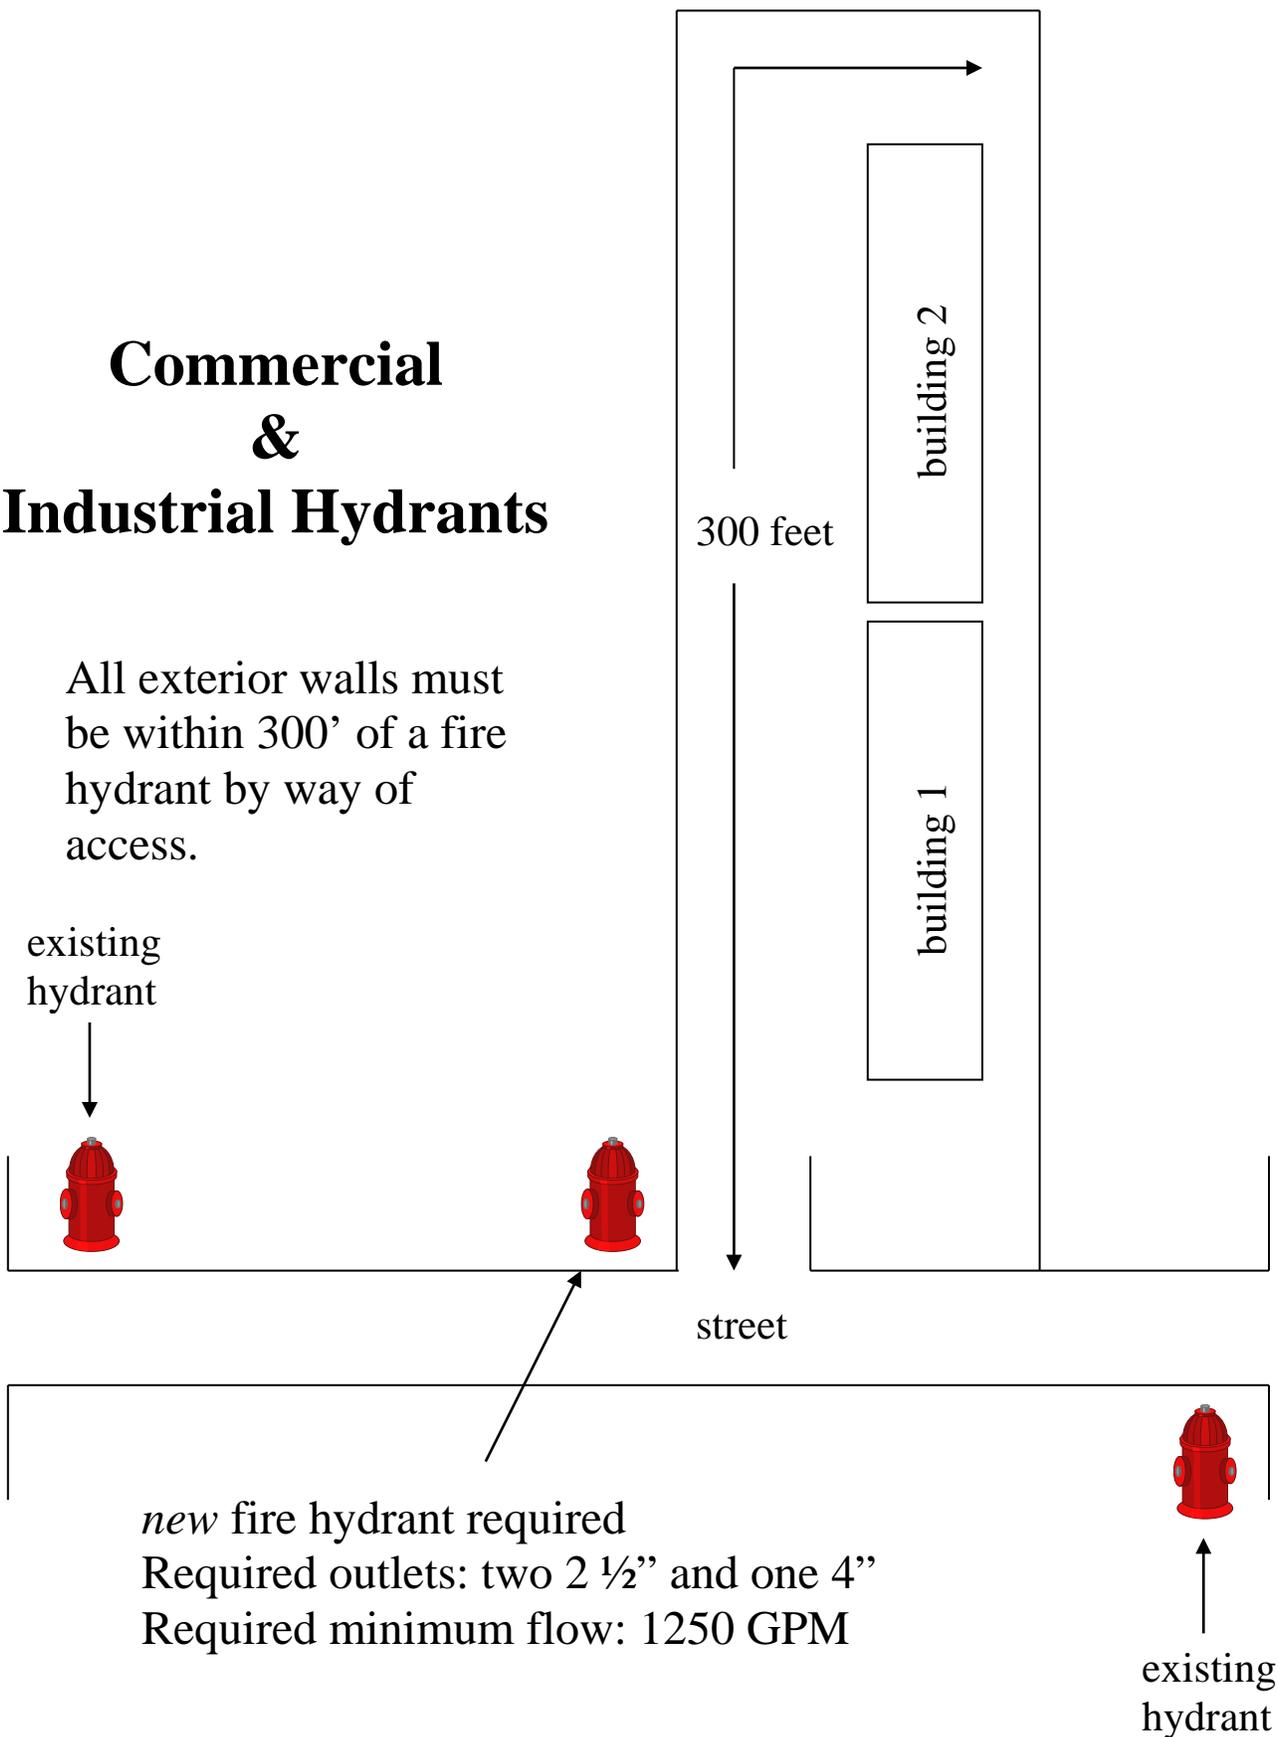

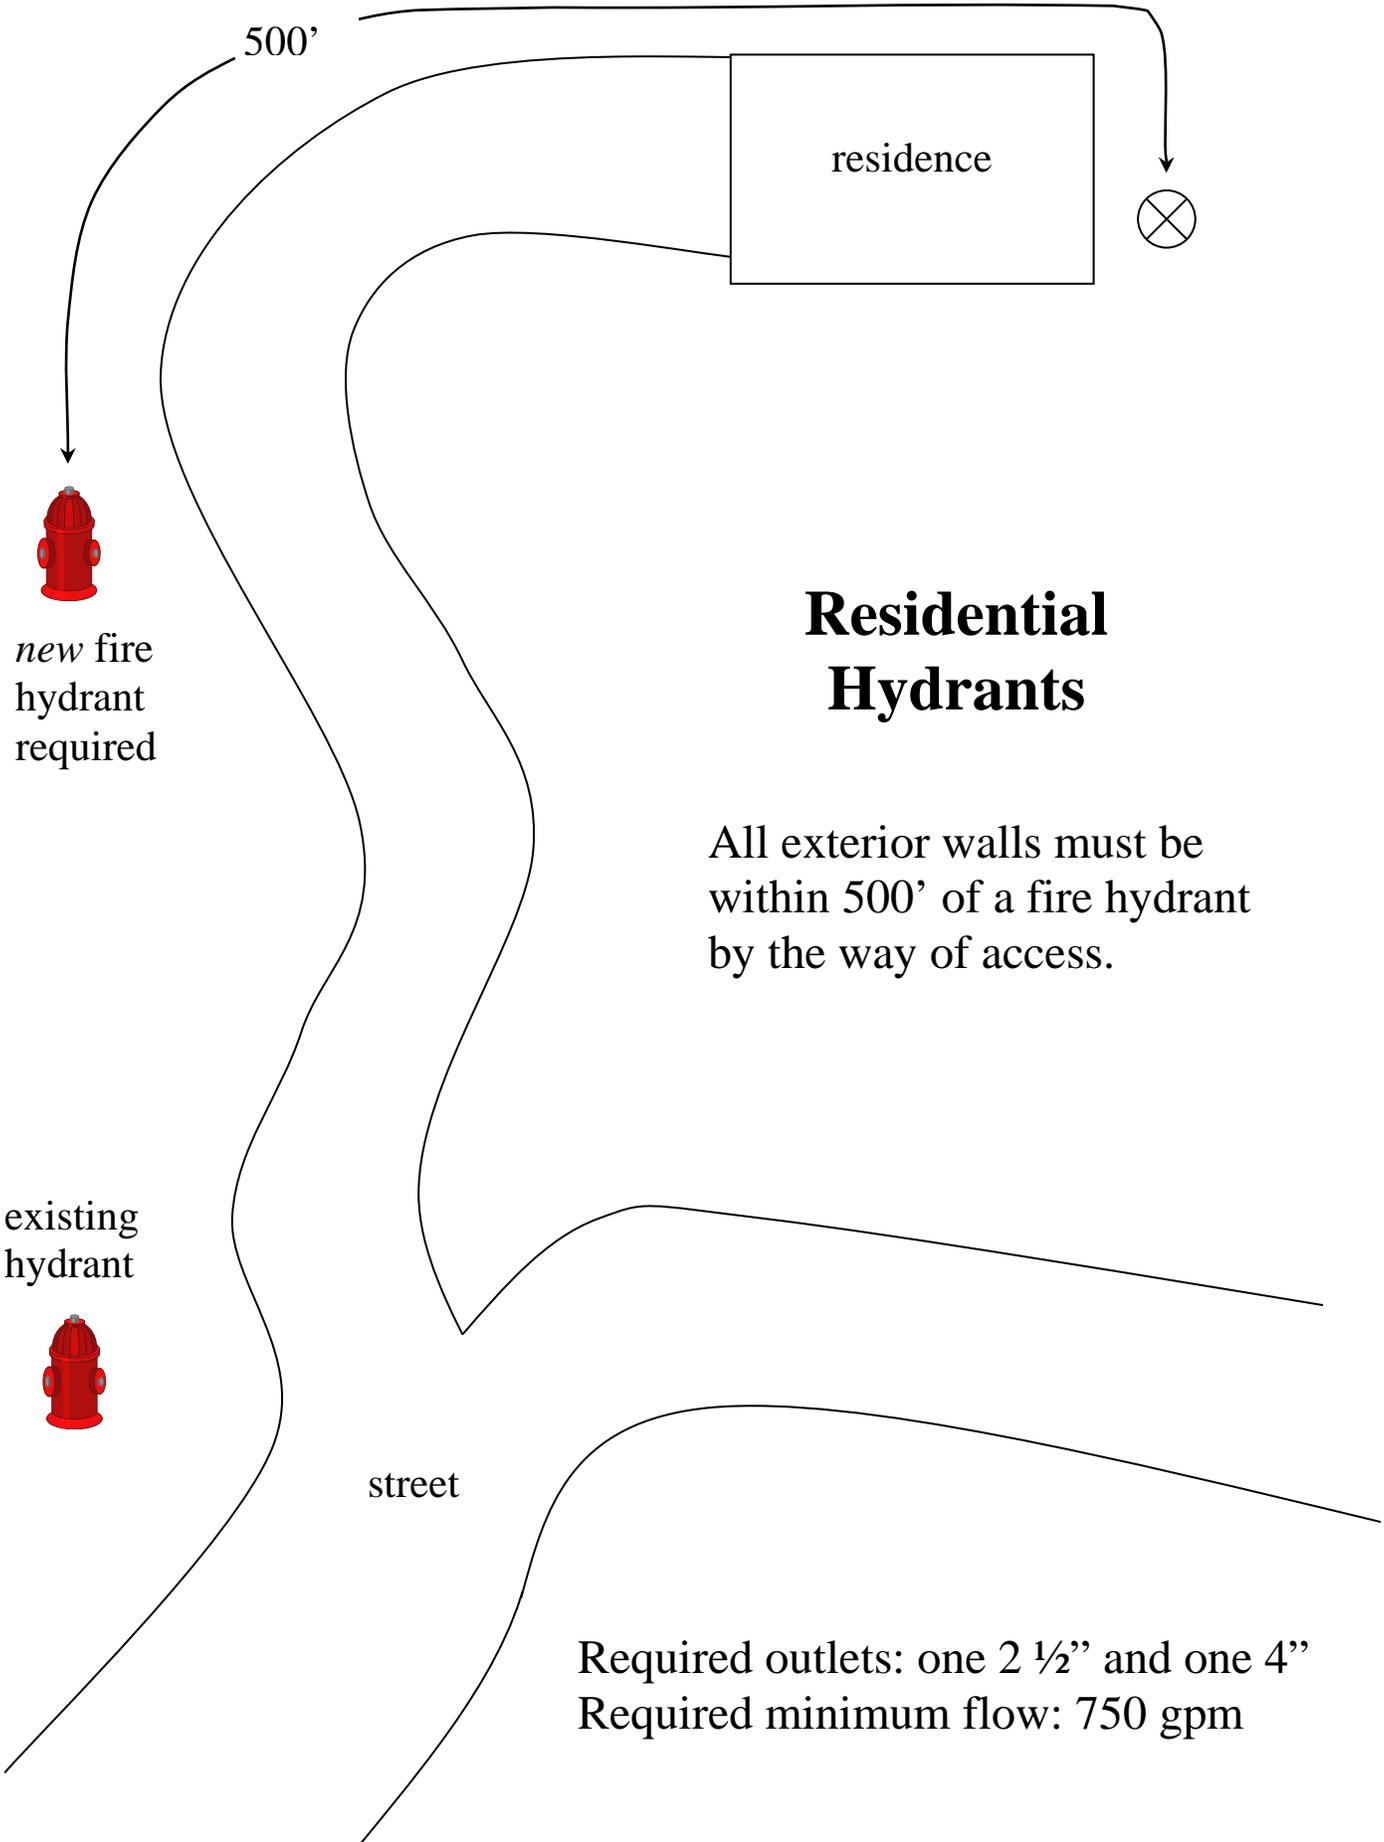

# Residential Hydrants

All exterior walls must be within 500' of a fire hydrant by the way of access.


Required outlets: one 2 1/2" and one 4"  
Required minimum flow: 750 gpm


# Driveway Requirements:


## *Apartments or Commercial Occupancy*

20' wide driveway to within 150' of the most remote exterior wall

Vertical driveway clearance to be an unobstructed 13' 6"

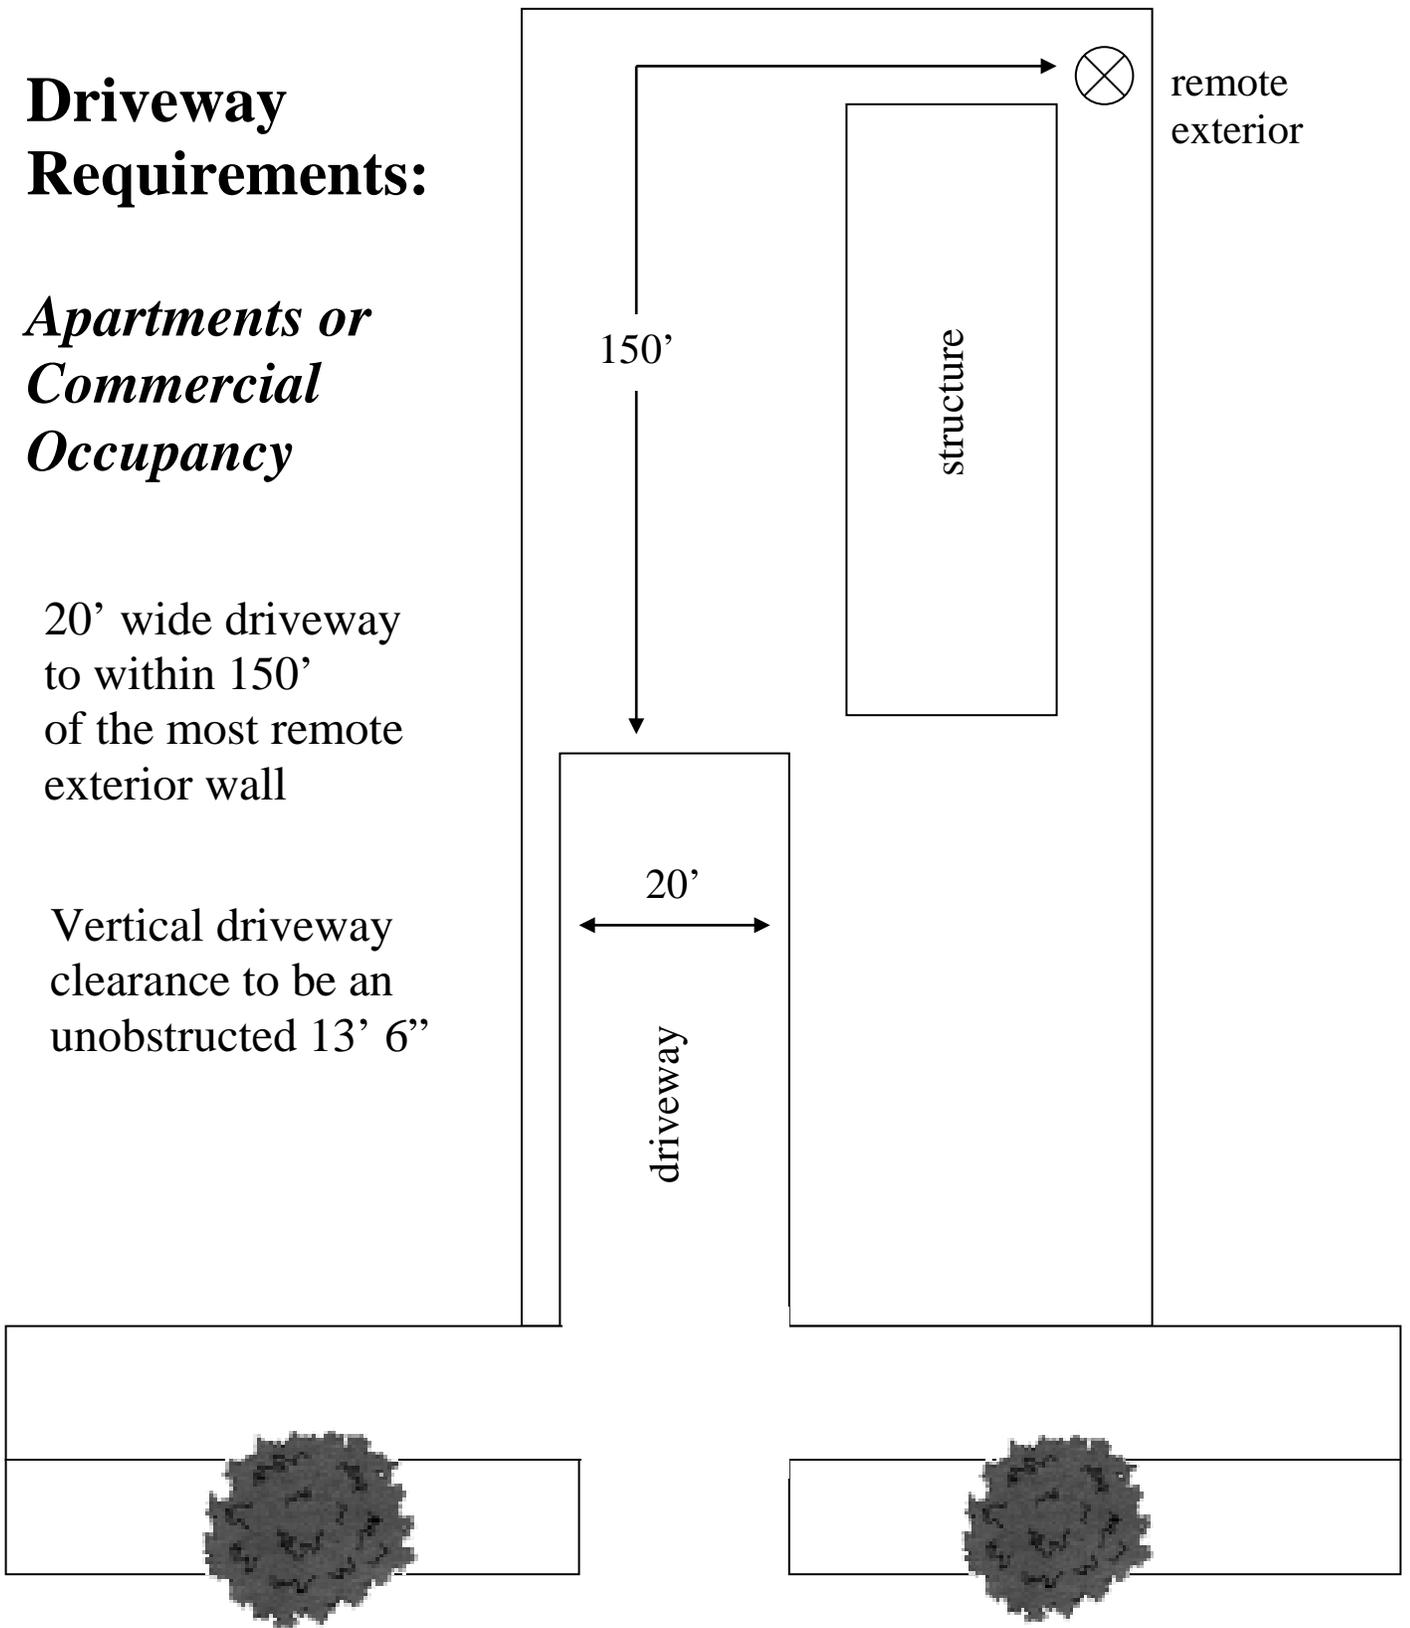


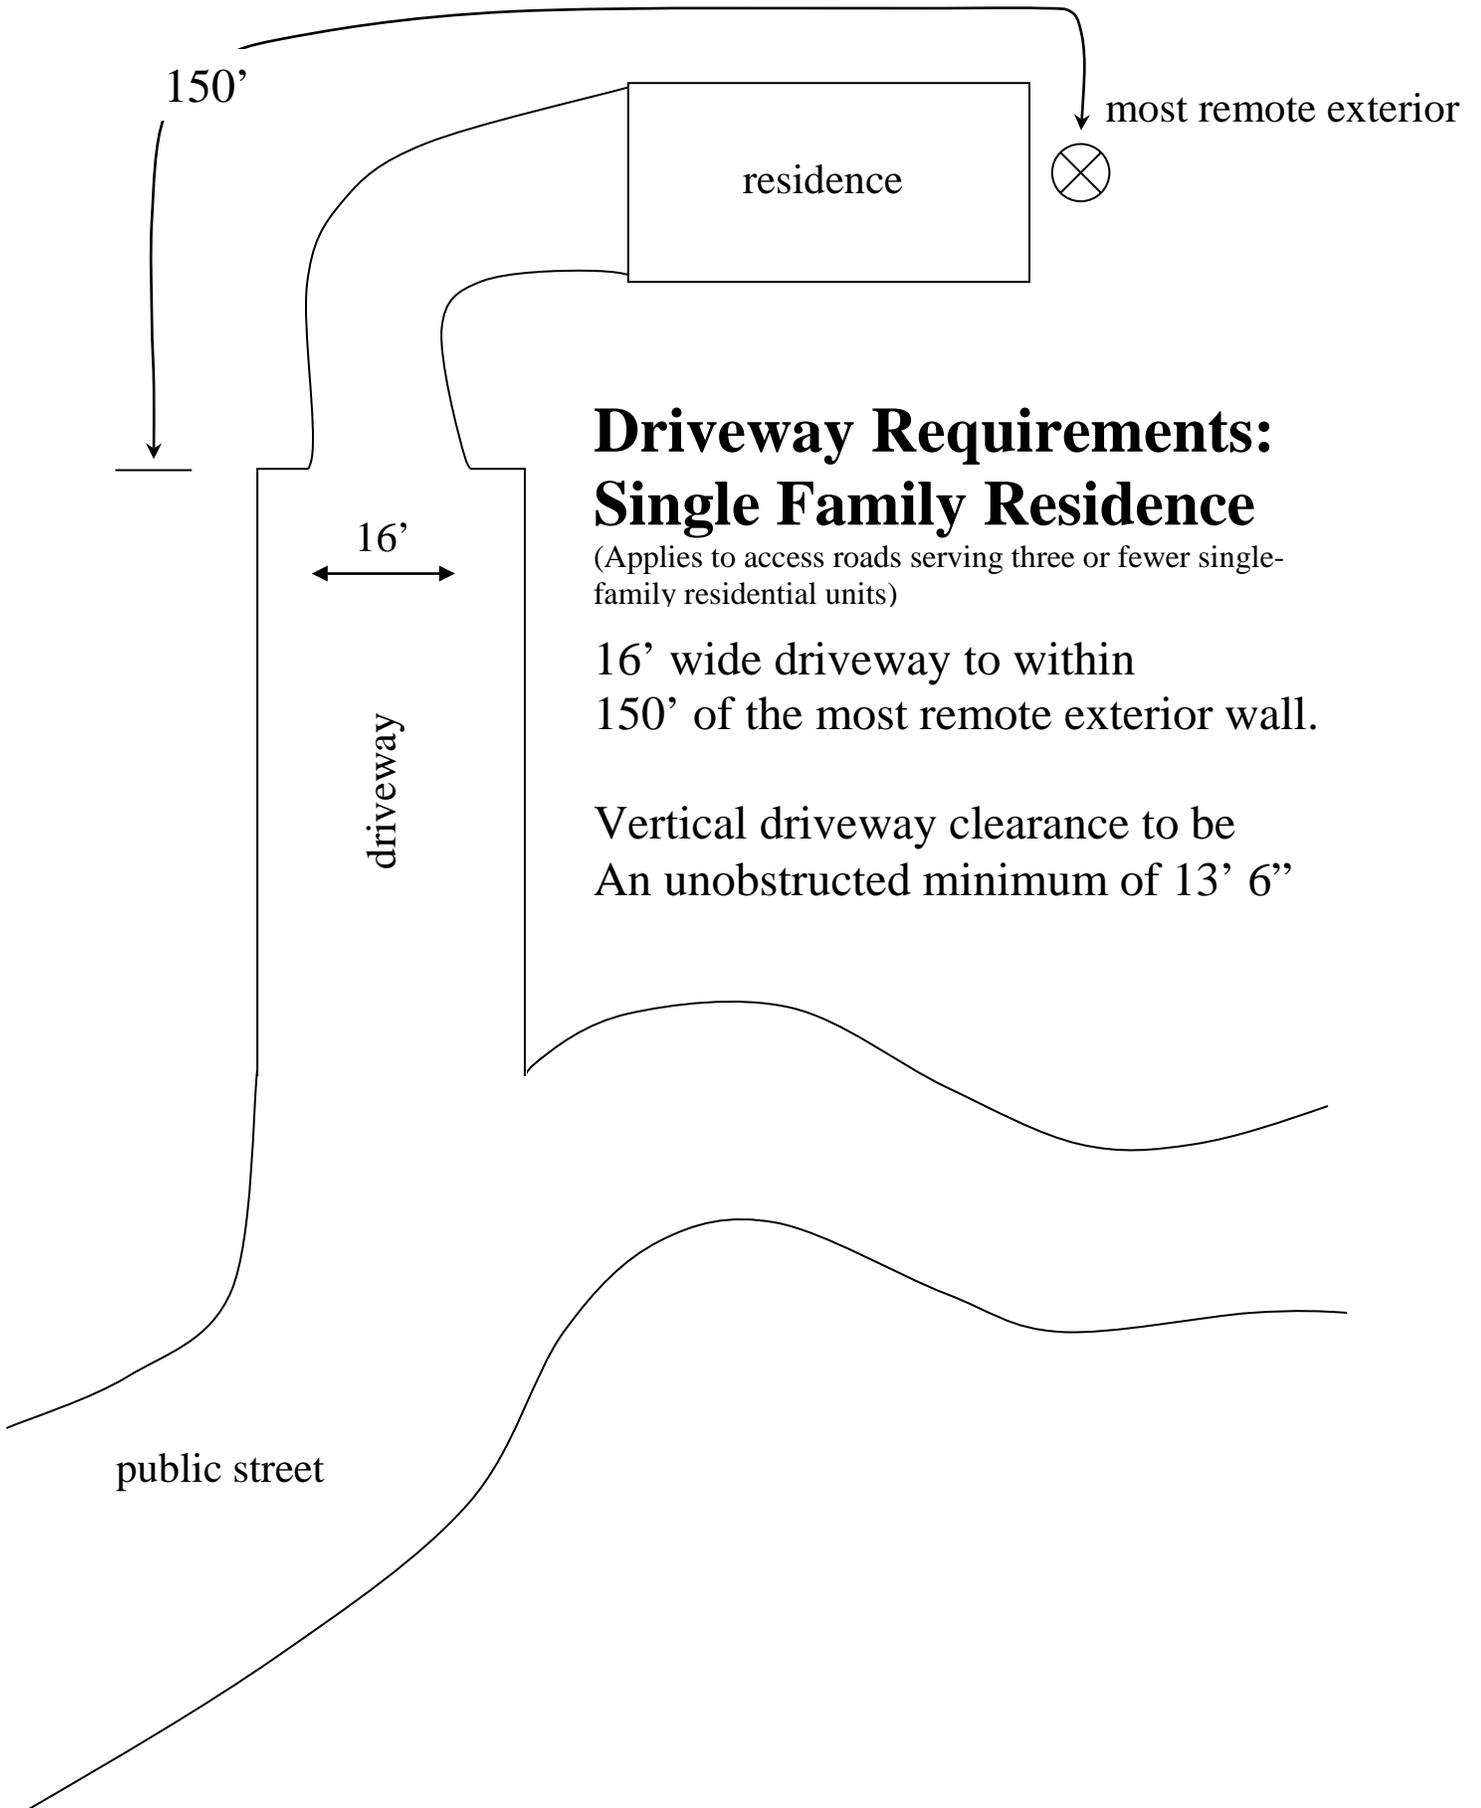

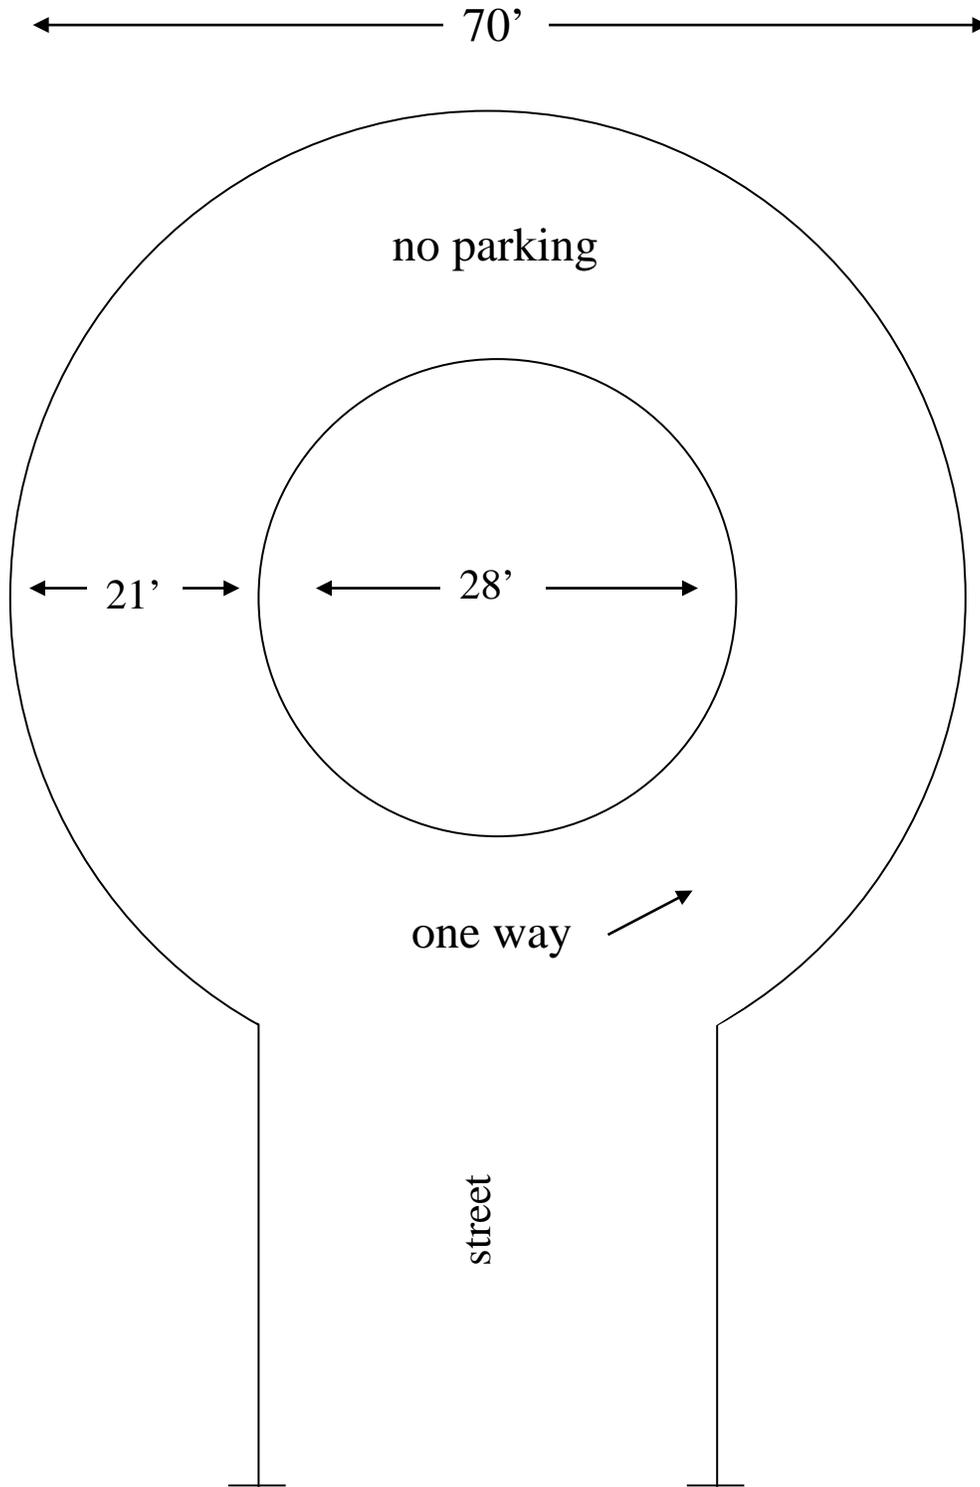

## **Minimum Cul de Sac Requirements**


(maximum planter shown)

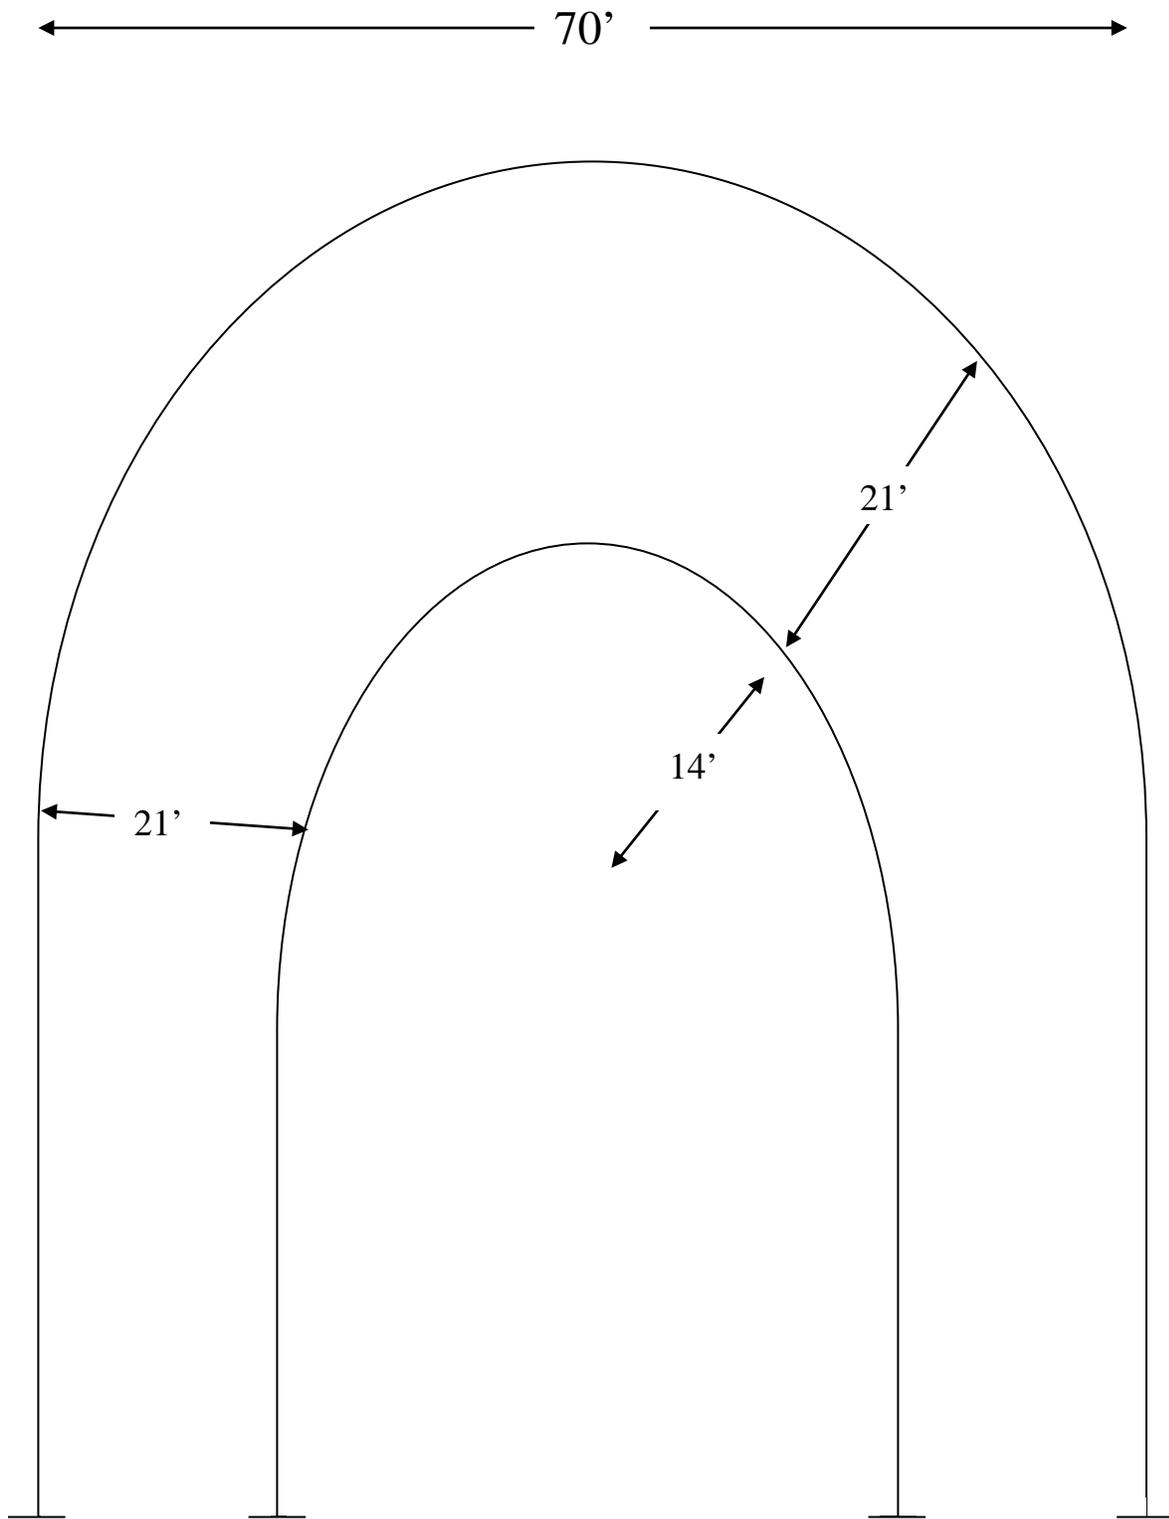


**Minimum Turning Radius**  
(switchbacks)

# Hammerhead Turnaround Location

Required when driveway exceeds 300'

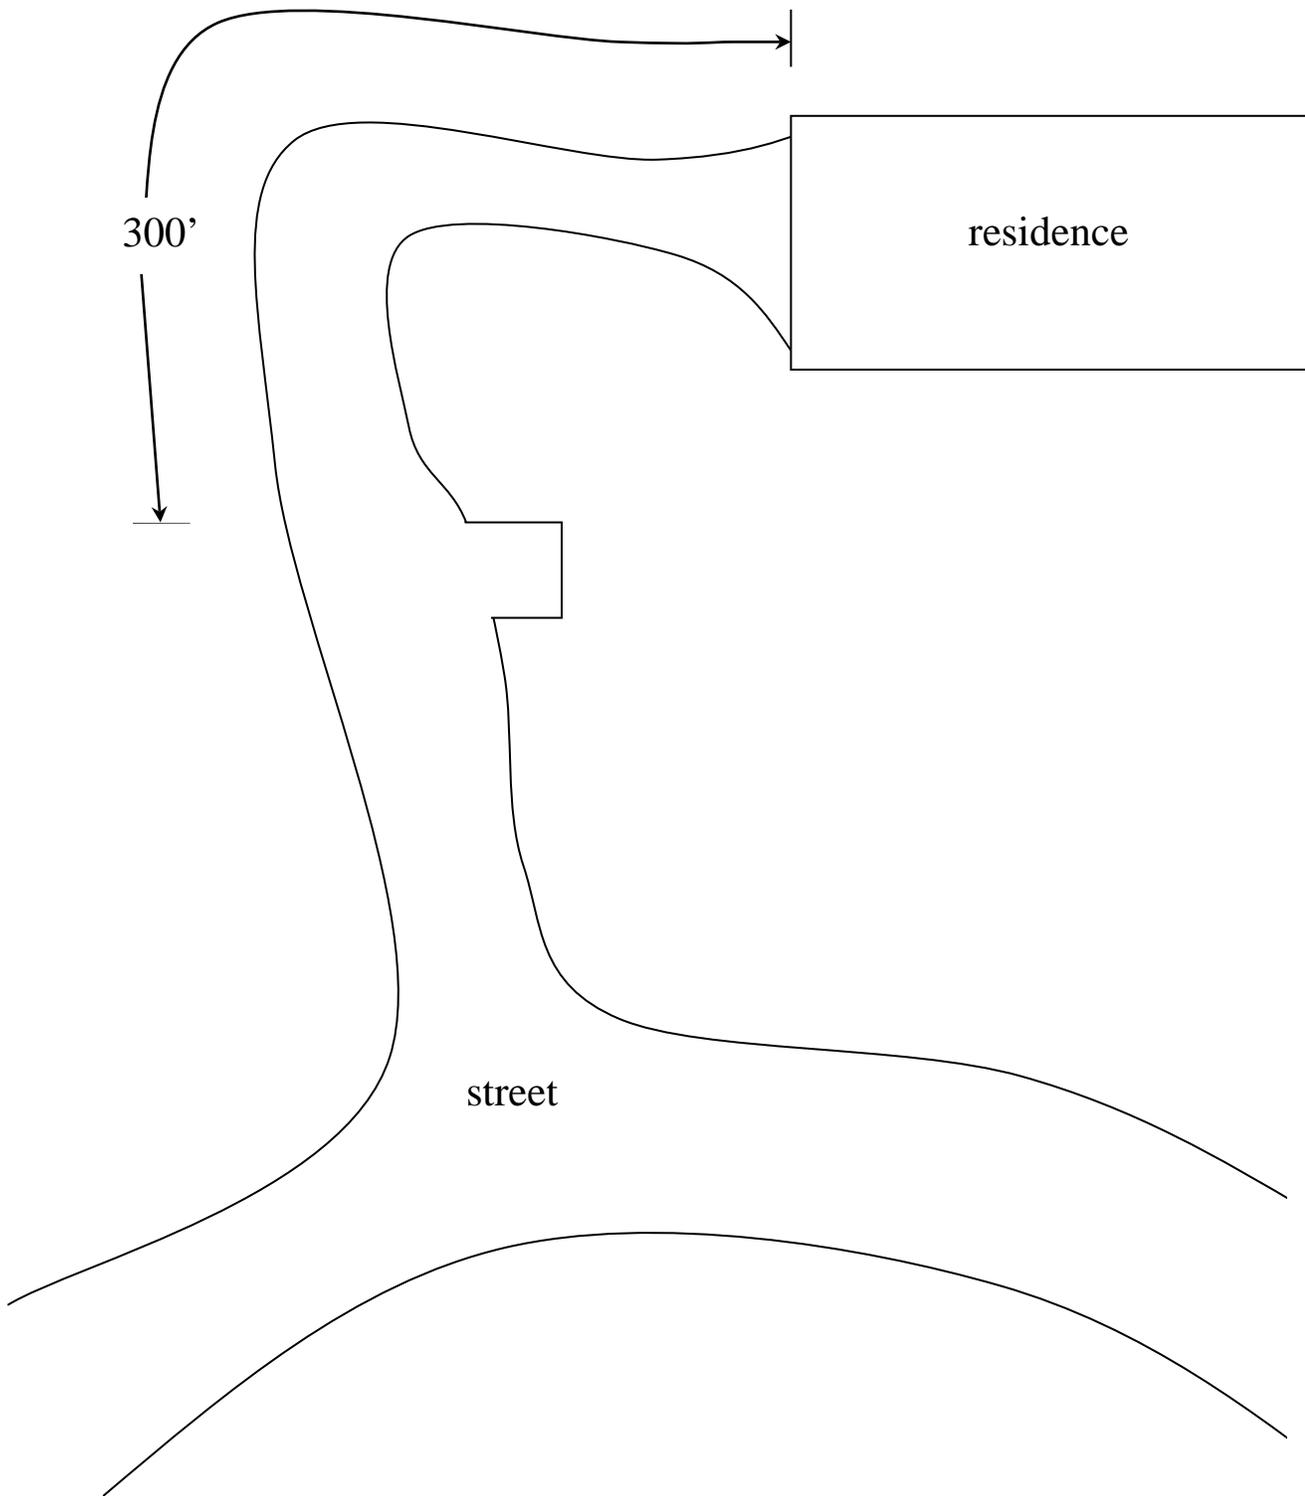


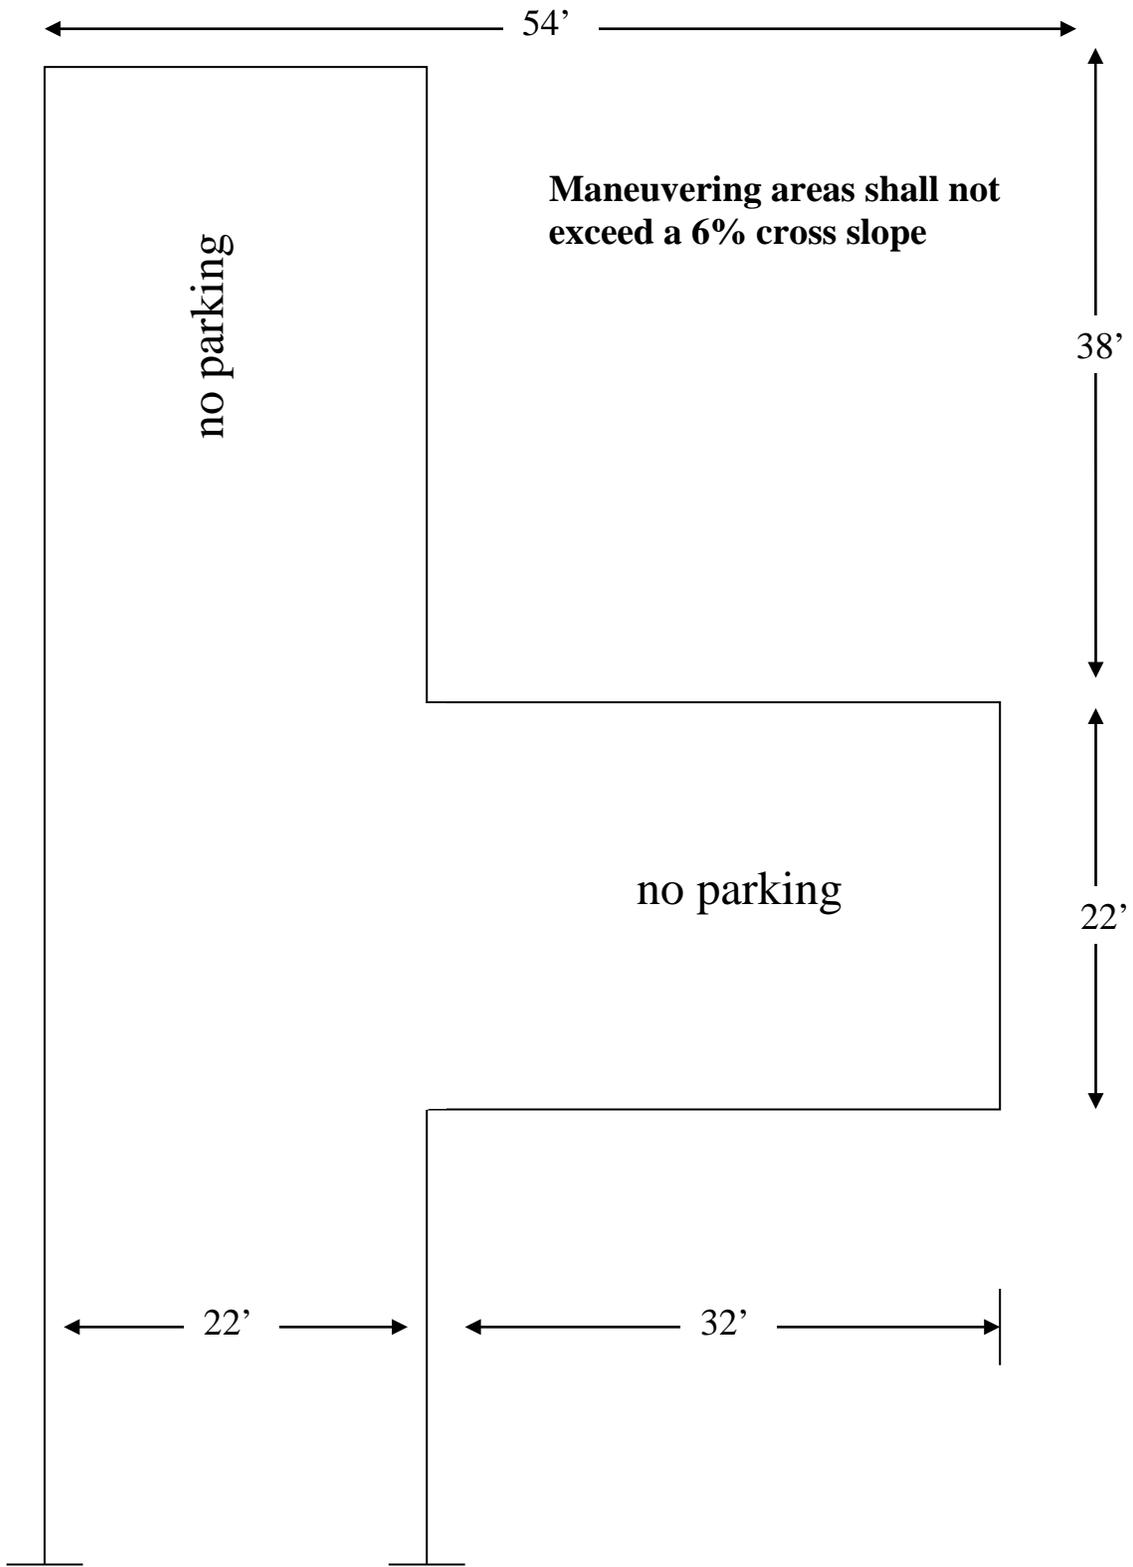

## **Minimum Hammerhead Turnaround Requirements**

# Access/Driveway Construction/Slope Requirements

All weather concrete or asphalt pavement must support 60,000 pounds.



Driveway access shall not have a slope in excess of 16%

Access within maneuvering area shall not exceed a 6% cross slope

